

Thursby, Kim

From: Epost HWRS
Sent: Wednesday, December 03, 2008 3:40 PM
To: 'BParkes@cliffberryinc.com'
Cc: 'ambrosefox@bellsouth.net'; Perry, Jenna D.; Posner, Augusta; Patel, Ashwin; Hornbrook, Frank; Wick, Fred; Neves, Richard; Bahr, Tim
Subject: Used Oil Transfer and Used Oil Processing Facility Permit Minor Modifications
Attachments: Permit Mod package.pdf

In an effort to provide a more efficient service, the Florida Department of Environmental Protection's Hazardous Waste Regulation Section is forwarding the attached document to you by electronic correspondence "e-correspondence" in lieu of a hard copy through the normal postal service.

We ask that you verify receipt of this document by sending a "reply" message to epost_hwrs@dep.state.fl.us. (An automatic "reply message" is not sufficient to verify receipt). If your email address has changed or you anticipate that it will change in the future, please advise accordingly in your reply. You may also update this information by contacting Kim Thursby at (850) 245-8792.

The attached document is in "pdf" format and will require Adobe Reader 6 or higher to open properly. You may download a free copy of this software at www.adobe.com/products/acrobat/readstep2.html.

Please note that our documents are sent virus free. However, if you use Norton Anti-virus software, a warning may appear when attempting to open the document. Please disregard this warning.

Your cooperation in helping us affect this process by replying as requested is greatly appreciated. If you should have any questions about the attached document(s), please direct your questions to the contact person listed in the correspondence.

Tim Bahr
Environmental Administrator
Hazardous Waste Regulation
Department of Environmental Protection
E-Mail Address: epost_hwrs@dep.state.fl.us

Tracking:

Recipient	Delivery	Read
'BParkes@cliffberryinc.com'		
'ambrosefox@bellsouth.net'		
Perry, Jenna D.	Delivered: 12/3/2008 3:40 PM	
Posner, Augusta	Delivered: 12/3/2008 3:40 PM	
Patel, Ashwin	Delivered: 12/3/2008 3:40 PM	
Hornbrook, Frank	Delivered: 12/3/2008 3:40 PM	
Wick, Fred	Delivered: 12/3/2008 3:40 PM	Read: 12/3/2008 11:21 AM
Neves, Richard	Delivered: 12/3/2008 3:40 PM	
Bahr, Tim	Delivered: 12/3/2008 3:40 PM	
Cook, Robert		Read: 12/3/2008 8:12 AM
Kothur, Bheem	Delivered: 12/3/2008 3:25 PM	
Dregne, James	Delivered: 12/3/2008 3:25 PM	



Florida Department of Environmental Protection

Bob Martinez Center
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Charlie Crist
Governor

Jeff Kottkamp
Lt. Governor

Michael W. Sole
Secretary

December 03, 2008

SENT VIA E-MAIL

BParkes@cliffberryinc.com

William E. Parkes, Jr.
Manager, Regulatory Affairs and Capital Projects
Cliff Berry, Incorporated
P.O. Box: 13079
Fort Lauderdale, Florida 33316

RE: Cliff Berry, Inc.
EPA I.D. No. FLR 000 119 784
Permit No. 249482-HO-002
Used Oil Transfer and Used Oil Processing Facility Permit Minor Modifications
Duval County

Dear Mr. Parkes:

The Department of Environmental Protection (DEP) has received your letter (dated November 18, 2008) requesting a minor modification to the above referenced permit to include a Used Oil Transfer Facility, which shall store less than 25,000 gallons of used oil for less than 35 days.

DEP has also received additional information, including a revised Form 8700-12FL, a Transfer Facility as-built tank layout plan, a Tank Table, Part I of the Used Oil Processing Facility Permit Application Form (including signature and certification pages) and a check in the amount of \$50.00 to satisfy the minor modification fee required by Florida Statute.

DEP has completed its review of your request for a minor permit modification and all other supporting documents submitted to this Department and hereby approves the Used Oil Transfer Facility plan. A copy of this letter must be attached to the existing permit which was issued on April 14, 2008 to the above facility and will become part of the permit.


The facility shall install a berm at the southern edge of the secondary containment area to eliminate storm water run-on within 30 days as specified in the e-mail correspondence of November 26, 2008.

William E. Parkes, Jr.,
Manager, Regulatory Affairs and Capital Projects
December 2, 2008
Page Two

There are no other changes to this permit.

If you have any questions, please contact Rick Neves at (850) 245-8755 or via e-mail: Richard.neves@dep.state.fl.us, or Bheem Kothur at (850) 245-8781 or via e-mail: bheem.kothur@dep.state.fl.us.

Sincerely,




Charles F. Goddard, Chief
Bureau of Solid & Hazardous Waste

CFG/bk
Enclosures: Site Map; Tank Table

cc: Augusta Posner, OGC/Tallahassee, augusta.posner@dep.state.fl.us
Ashwin Patel, DEP/Northeast, ashwin.patel@dep.state.fl.us
Frank Hornbrook/Tallahassee, frank.hornbrook@dep.state.fl.us
Fred Wick, DEP/Tallahassee, fred.wick@dep.state.fl.us
D.M. Ambrose, ambrosefox@bellsouth.net
Jenna Perry, DEP/Northeast, jenna.perry@dep.state.fl.us

FILING AND ACKNOWLEDGMENT

Filed on this date, pursuant to Section 120.52(11), Florida Statutes, with the designated Department clerk, receipt of which is hereby acknowledged.





CLERK

December 2, 2008

DATE

Enclosure 1: Site Map

DATE: Sep 22, 2008 - 3:38pm P:\projects\050912\encl1\cib_jacksonville\lpc\encl1.dwg

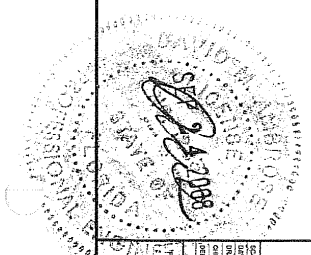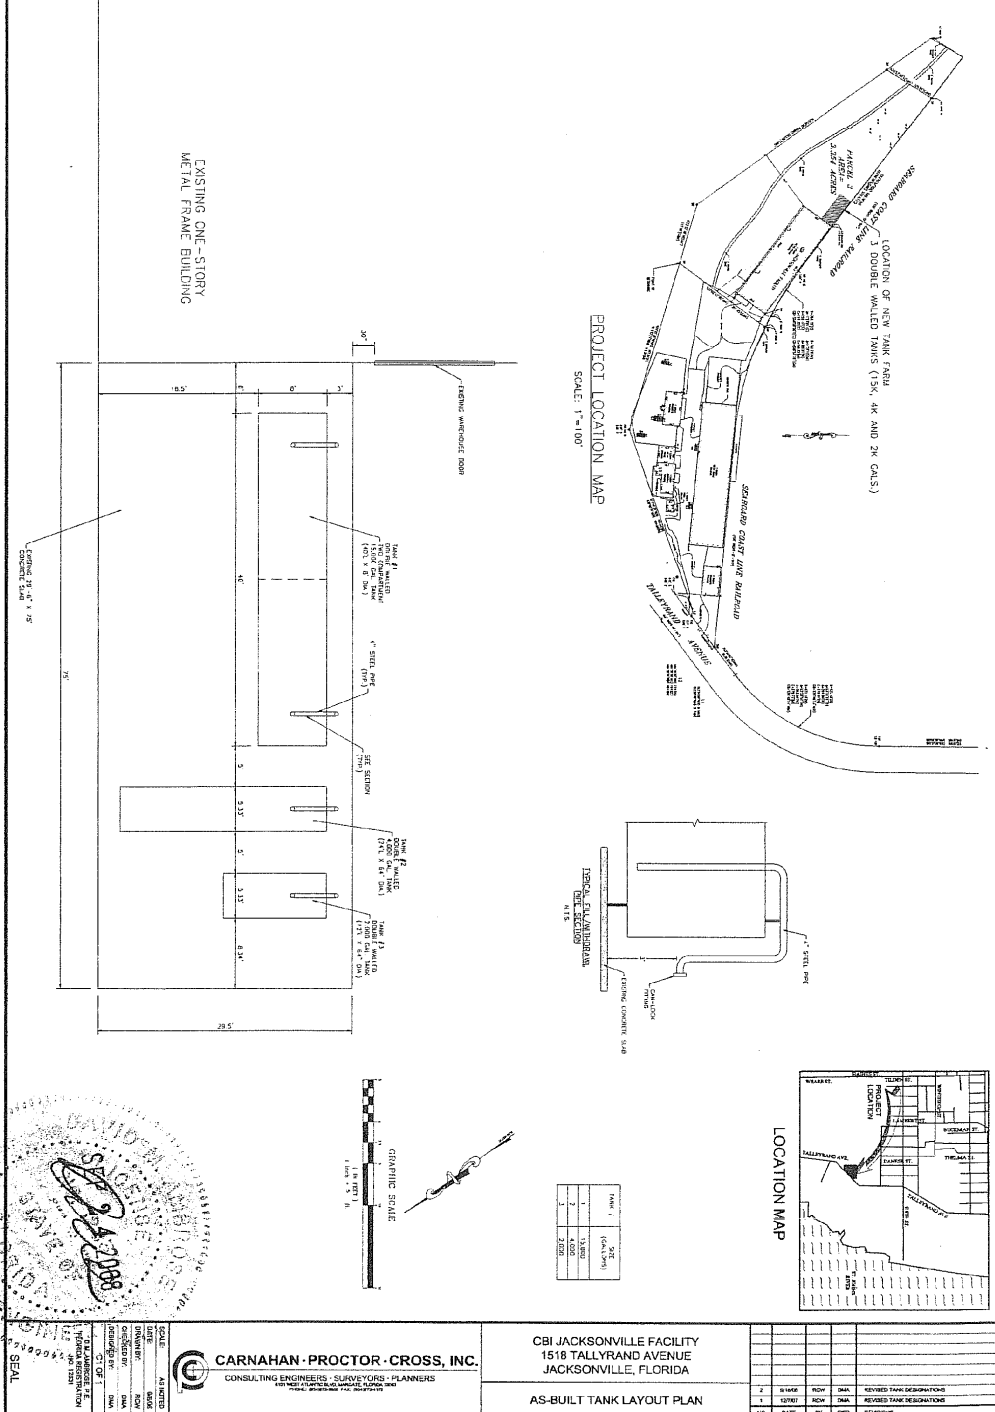

CARNAHAN · PROCTOR · CROSS, INC.
 CONSULTING ENGINEERS · SURVEYORS · PLANNERS
 410 WEST PALM BEACH AVENUE, SUITE 200
 WEST PALM BEACH, FLORIDA 33411
 TEL: 561-832-1100 FAX: 561-832-1101
 WWW.CPCROSS.COM

CBI JACKSONVILLE FACILITY
 1518 TALLYRAND AVENUE
 JACKSONVILLE, FLORIDA

AS-BUILT TANK LAYOUT PLAN

Enclosure 2: Tank Table

Horizontal Tanks

Tank #	Date Installed	Size (Gallons)	Material of Construction	Products
1	10/08	15,000	Steel	Used Oil / Water
2	10/08	4,000	Steel	Used Oil / Water
3	10/08	2,000	Steel	PCW

Note: The three (3) storage tanks are double walled tanks and therefore do not need secondary containment.

FACT SHEET
December 03, 2008
CBI, Inc. – Jacksonville Facility
Jacksonville, Florida
EPA I.D. No: FLR 000 119 784
Permit No: 249482-HO-002

Used Oil Transfer and Material Processing Facility Permit

1. This is a minor permit modification to the facility's existing permit to operate a Used Oil transfer station consisting of three (3) storage tanks.
2. This permit modification is for adding three (3) tanks, Tank 1, Tank 2, and Tank 3 with capacities of 15000, 4000, and 2000 gallons of Used Oil/Water; Used Oil/Water; and Petroleum Contact Water (PCW), respectively.
3. The transfer station facility was inspected by the district office.
4. The district requested the facility install a berm at the southern edge of the secondary containment to eliminate storm water run-on within 30 days or to come-up with an alternate schedule to perform the work and inform the department to re-visit the facility.
5. There are no issues with this permit or with the facility.