


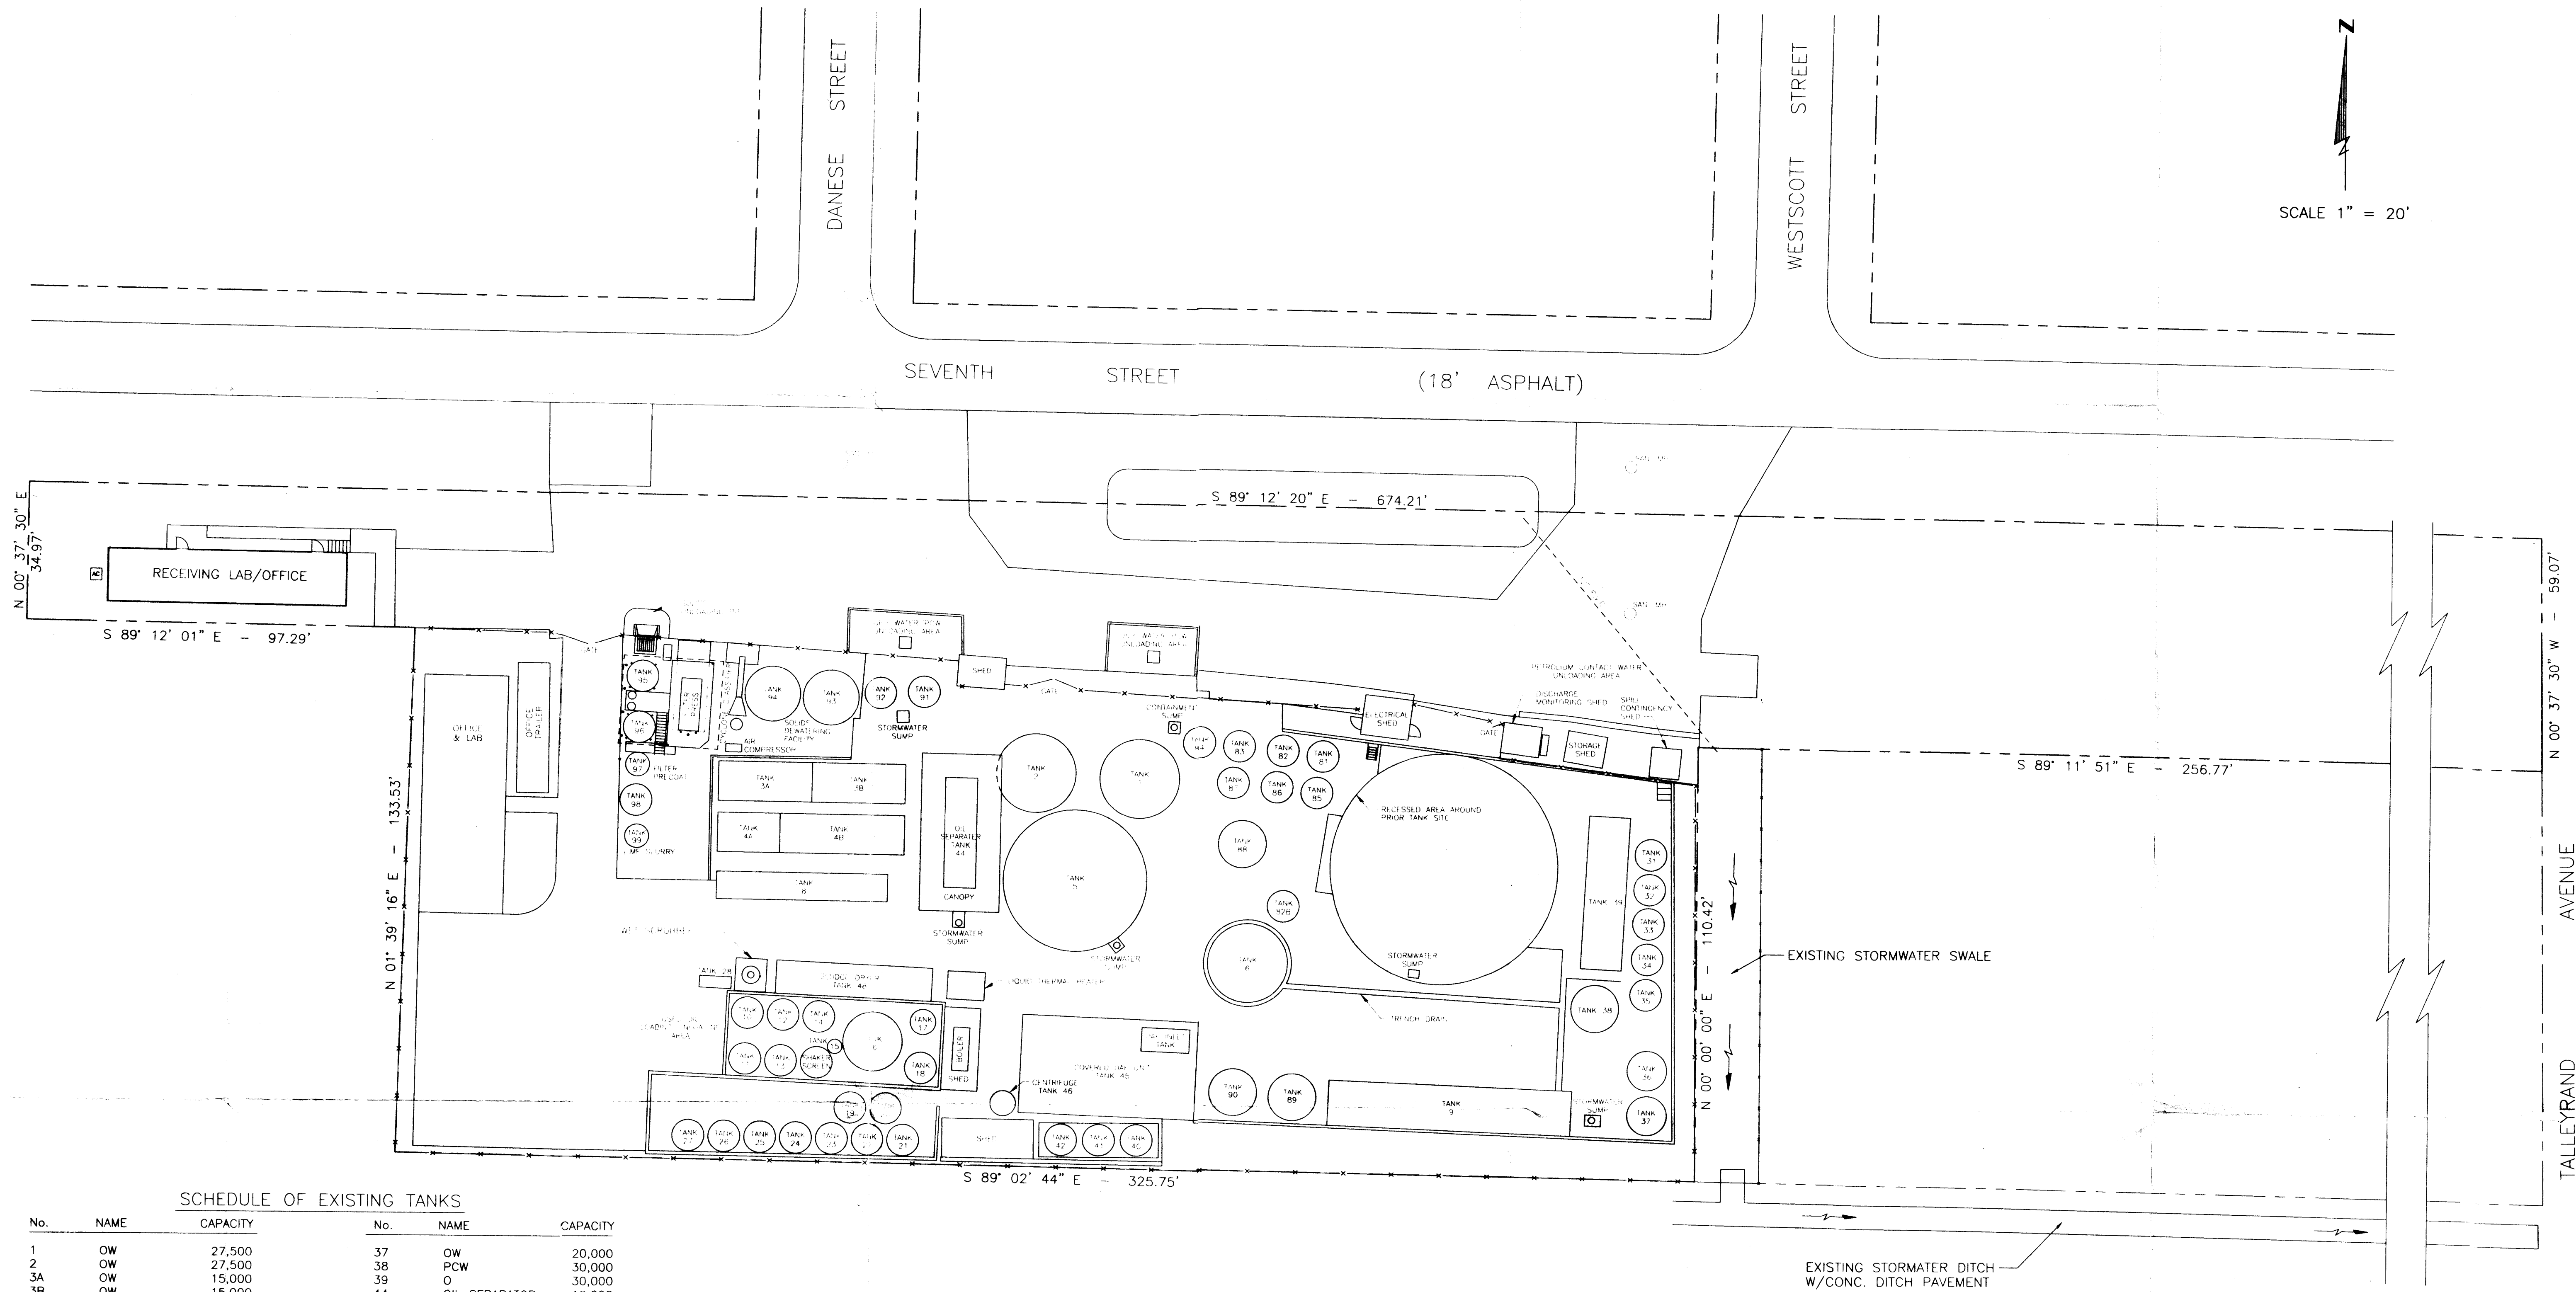

SCHEDULE OF EXISTING TANKS

No.	NAME	CAPACITY	No.	NAME	CAPACITY
1	OW	27,500	37	OW	20,000
2	OW	27,500	38	PCW	30,000
3A	OW	15,000	39	O	30,000
3B	OW	15,000	44	OIL SEPARATOR	10,000
4A	OW	10,000	45	DAF UNIT	34,000
4B	S	20,000	45A	DAF INLET	1,000
5	OW	210,000	46	CENTRIFUGE	N/A
6	PCW	62,000	48	SLUDGE DRYER	N/A
8	OW	11,000	81	OW	5,000
9	W	40,000	82	OW	5,000
10	O	6,000	82B	OW	1,000
11	O	6,000	83	OW	5,500
12	O	8,000	84	OW	5,500
13	O	6,000	85	OW	6,000
14	O	8,000	86	OW	6,000
15	O	55	87	OW	6,000
16	O	16,000	88	OW	6,000
17	O	1,000	89	S	10,000
18	O	6,000	90	S	10,000
19	O	8,000	91	OW	5,000
20	O	8,000	92	OW	5,000
21	O	8,000	93	S/OW	12,000
22	O	8,000	94	S/OW	12,000
23	O	10,000	95	S	4,000
24	O	15,000	96	S	4,000
25	O	15,000	97	FILTER PRECOAT	1,000
26	O	15,000	98	W	12,000
27	O	8,000	99	LIME SLURRY	1,000
28	O	360	E40	OUT OF SERVICE	8,000
31	W	10,000	M41	OUT OF SERVICE	10,000
32	W	12,000	W42	OUT OF SERVICE	10,000
33	W	12,000			
34	W	12,000			
35	W	10,000			
36	W	20,000			

TANK LEGEND

O	-	OIL MANAGEMENT UNIT
OW	-	OILY WATER
PCW	-	PETROLEUM CONTACT WATER
S	-	SLUDGE OR SOLIDS
W	-	WATER

SCALE 1" = 20'

MITTAUER & ASSOCIATES, INC.
CONSULTING ENGINEERS
1202 Kingsley Avenue, Orange Park, Florida (904) 278-0030

INDUSTRIAL WATER SERVICES, INC.
Used Oil Processing Facility Permit
Topographic Map
Jacksonville, Florida

JOB NO.
9122-15-1
ATTACHMENT

B-3c
OF

REVISION DESCRIPTION

BY

DATE

NO

DESIGN
DRAWN
CHECKED
APPROVED
DATE 6/11/97