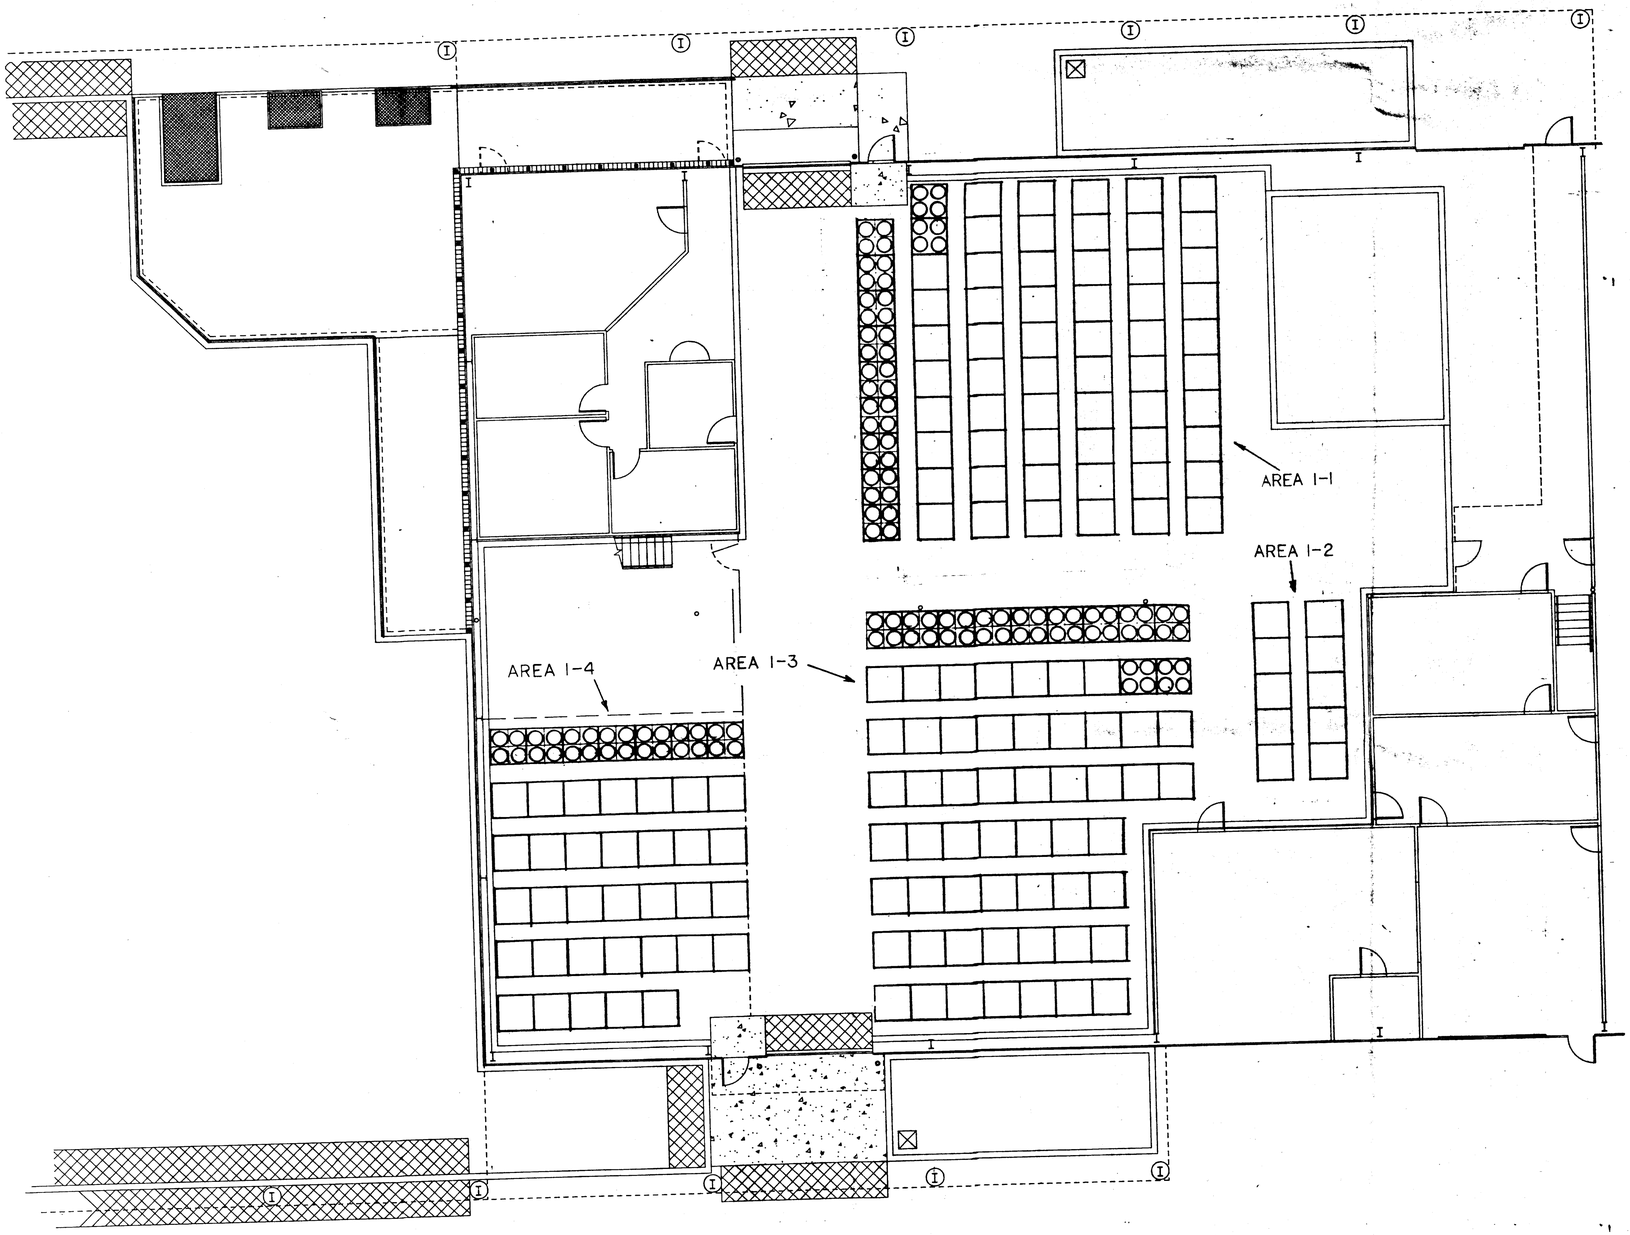


CONTAINER
STORAGE PATTERN

STORAGE CAPACITY FOR EACH AREA IS AS NOTED BELOW IN EQUIVALENT 55 GALLON DRUMS *. DRUMS MAY BE STACKED A MAX. OF TWO(2) HIGH ON PALLETS. PALLETS MUST BE USED FOR STACKING WITH A MAXIMUM OF FOUR(4) 55 GAL. DRUMS PER EACH PALLET.

AREA 1 - 1 = 552

AREA 1 - 2 = 80

AREA 1 - 3 = 512

AREA 1 - 4 = 320

* EQUIVALENT DRUMS (EXAMPLES)

1 30/35 GAL DRUM = .6 55 GAL DRUM
1 85 GAL DRUM = 1.6 55 GAL DRUM
1 D.O.T. 250 GAL TOTE CONTAINER = 4.6 55 GAL DRUM

SUMMARY OF TOTAL STORAGE

BLDG 1 = 1464

BLDG 1A = 672


BLDG 2 = 991 (ZONE 1=170, ZONE 2=514, & ZONE 3=307)

BLDG 2A = 1080

BLDG 2B = 720

NORTHEAST DISTRICT
RECEIVED
JUL 10 1991
DER-JACKSONVILLE

UNLESS OTHERWISE SPECIFIED	CHARGE No		Quadrex GAINESVILLE, FLORIDA
TOLERANCES ON 1 PL DECIMALS, 2 PL DECIMALS, 3 PL DECIMALS, FRACTIONS, ANGLES	DESIGNED	DATE	
	DRAWN JF	DATE	
	APPROVALS		
	ENGINEERING	DATE 7/5/91	STORAGE PATTERN
DO NOT SCALE DRAWING	PRODUCTION	DATE	
USED ON	QUALITY ASSURANCE	DATE	SIZE D / SCM No / DRWG No / SHT 1 OF 2
	A-P'D FOR BY	DATE	SCALE

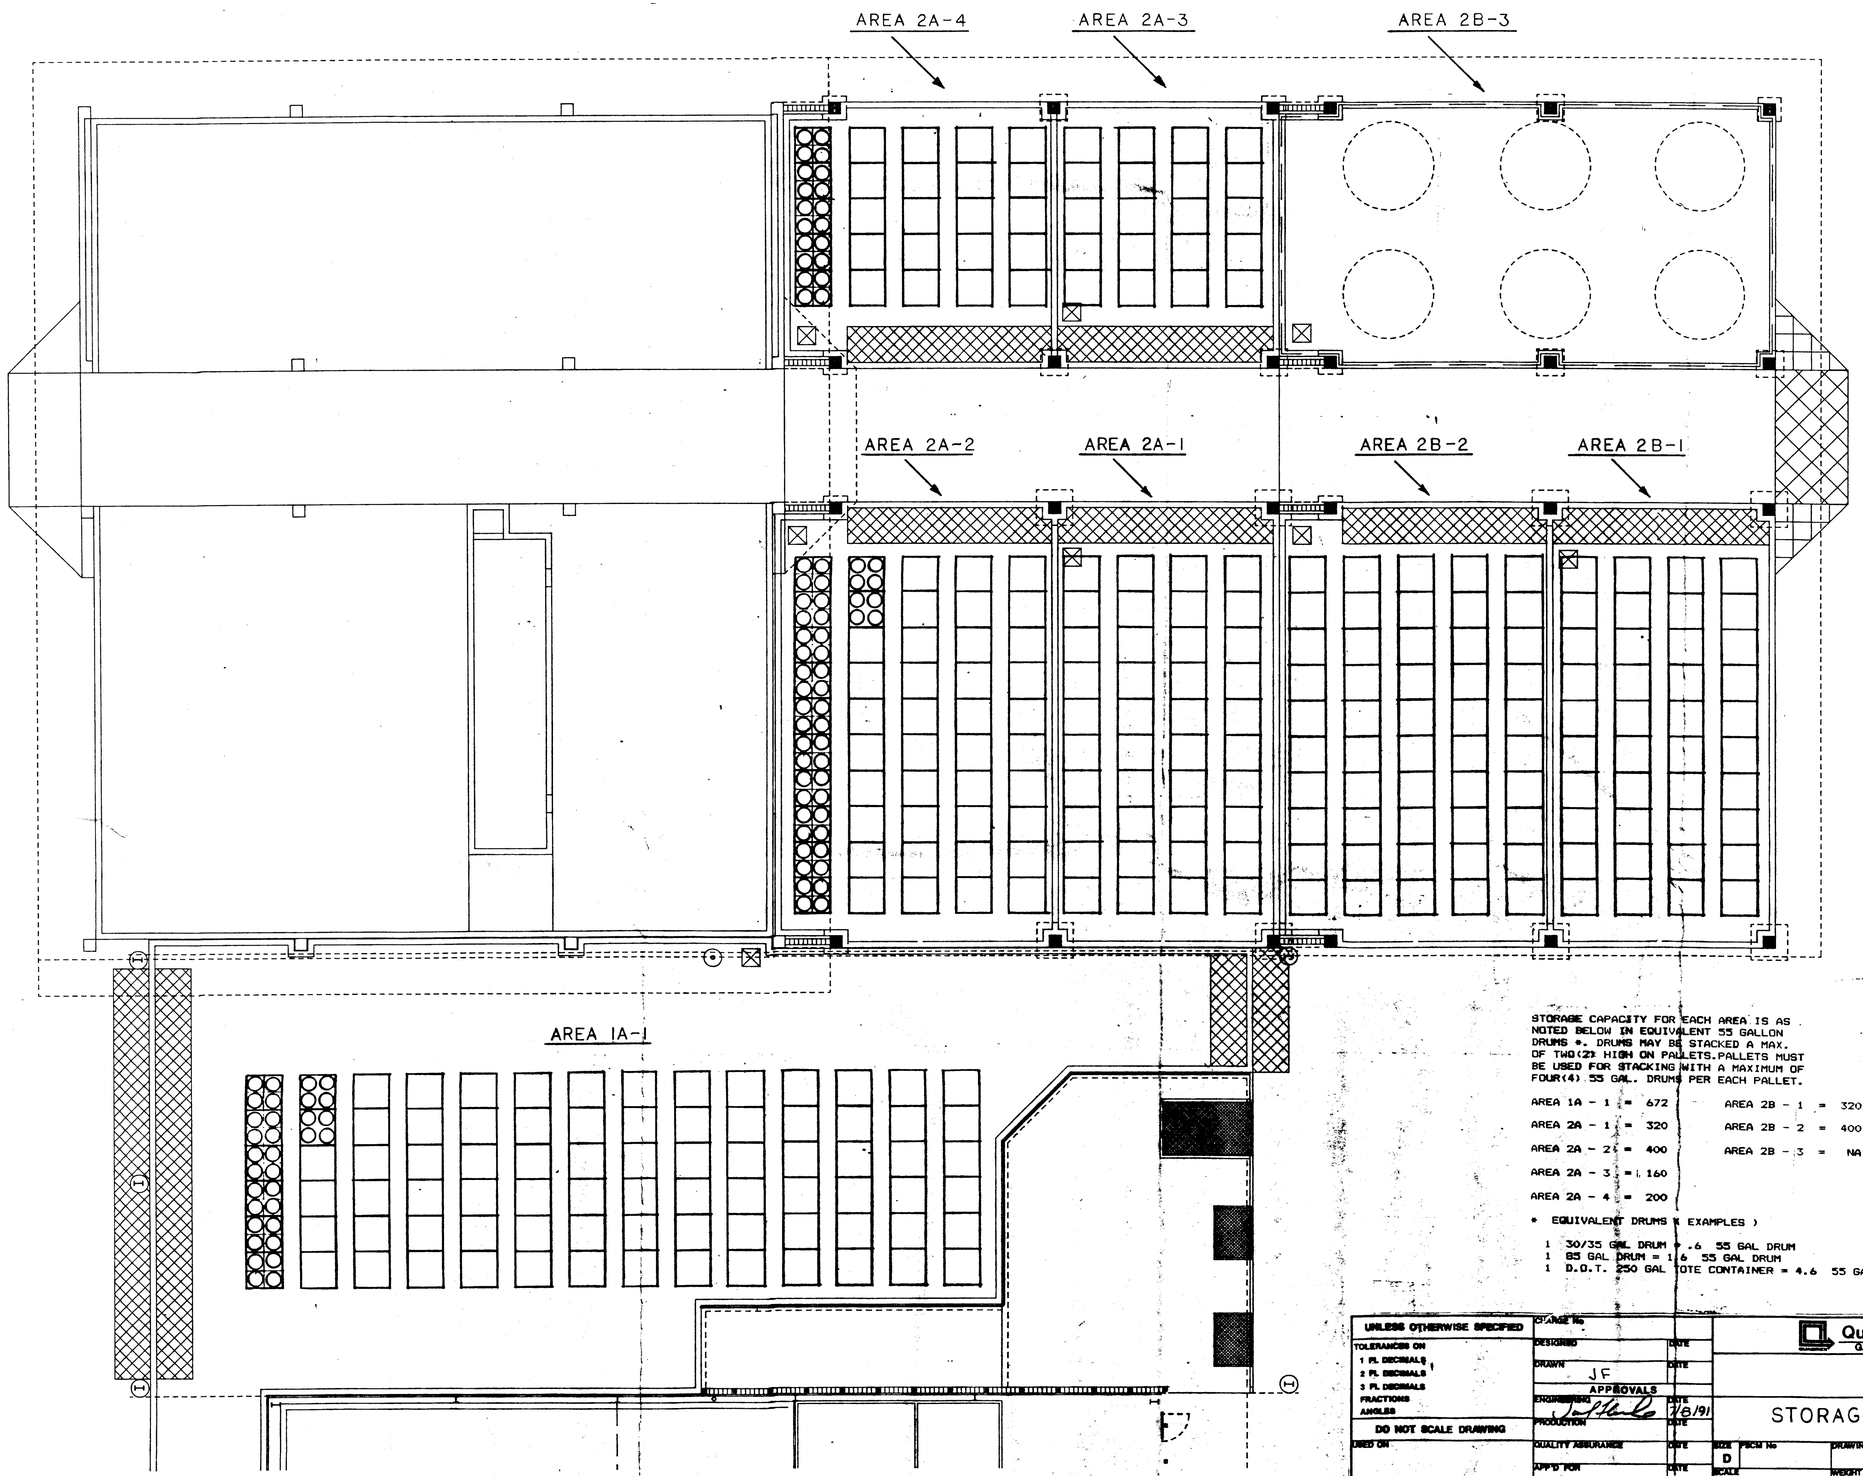

STORAGE CAPACITY FOR EACH AREA IS AS NOTED BELOW IN EQUIVALENT 55 GALLON DRUMS *. DRUMS MAY BE STACKED A MAX. OF TWO(2) HIGH ON PALLETS. PALLETS MUST BE USED FOR STACKING WITH A MAXIMUM OF FOUR(4) 55 GAL. DRUMS PER EACH PALLET.

AREA 1A - 1	= 672	AREA 2B - 1	= 320
AREA 2A - 1	= 320	AREA 2B - 2	= 400
AREA 2A - 2	= 400	AREA 2B - 3	= NA
AREA 2A - 3	= 160		
AREA 2A - 4	= 200		

* EQUIVALENT DRUMS (EXAMPLES)

1 30/35 GAL DRUM = .6 55 GAL DRUM
1 85 GAL DRUM = 1.6 55 GAL DRUM
1 D.O.T. 250 GAL TOTE CONTAINER = 4.6 55 GAL DRUM

UNLESS OTHERWISE SPECIFIED	CHANGE No.		Quadrex HPS Inc. GAINESVILLE, FLORIDA
TOLERANCES ON 1 PL DECIMALS, 2 PL DECIMALS, 3 PL DECIMALS, FRACTIONS, ANGLES	DESIGNED	DATE	
	DRAWN JF	DATE	
	APPROVALS		
DO NOT SCALE DRAWING	ENGINEERING	DATE 7/8/91	STORAGE PATTERN
USED ON	PRODUCTION	DATE	
	QUALITY ASSURANCE	DATE	SIZE D, PECM No, DRAWING No, REV
	APP'D FOR BY	DATE	SCALE, WEIGHT, SHEET 2 OF 2