


DESIGN: UL 142 STD. TEMP. AND PRESSURE
BUILT: APPROXIMATELY 1980 BY BUFFALO TANK CO.
INSPECTED: AUGUST 5, 1997
10'-6" DIAMETER X 23'-3" HIGH
15,000 GALLON CAPACITY
BUTT WELDED VERTICAL SEAMS
LAP WELDED HORIZONTAL SEAMS

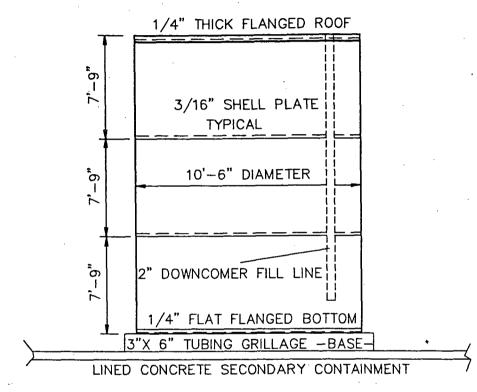

DIRTY MINERAL SPIRITS STORAGE TANK - ORANGE PARK, FLORIDA

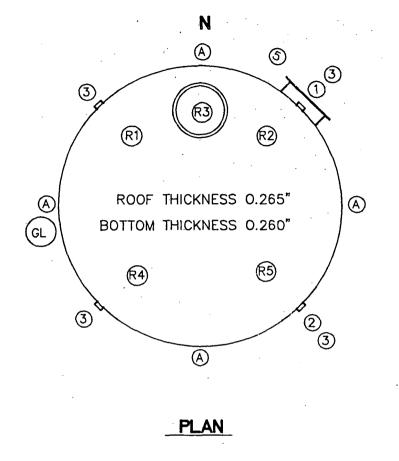

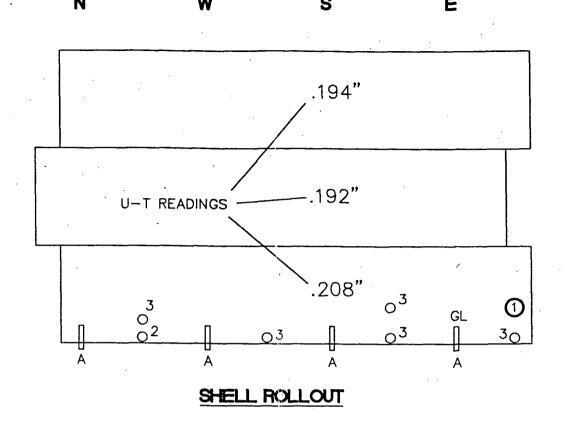

ELEVATION


NOTES:

- 1. SHELL RUSTING BEHIND UL 142 NAMEPLATE LOCATED ABOVE MANWAY.
- 2. SHELL COATING IN GOOD CONDITION COATING BEGINNING TO FAIL ON UPPER SHELL COURSE.
- 3. U-T READINGS DO NOT INDICATE ANY INTERIOR CORROSION.
- 4. NO INTERNAL CORROSION FOUND DURING INTERIOR INSPECTION.
- 5. NO VISIBLE SIGNS OF TANK LEAKAGE.
- 6. TANK IS IN GOOD CONDITION BASED ON THIS INSPECTION

INSPECTOR: DANIEL E. COLEMAN EI - API CERTIFICATION #0867

AST INSPECTION SERVICES, INC.

PO BOX 902 MADISON, FLORIDA 32341 PHONE: (912) 244-9826



FOR:

SAFETY-KLEEN CORP.

ORANGE PARK BRANCH ORANGE PARK, FLORIDA PROJECT:

OUT OF SERVICE INSPECTION
DIRTY MINERAL SPIRITS
STORAGE TANK

NOZZLES, FITTINGS AND ACCESSORIES

SYMBOL	DESCRIPTION	INSPECTION NOTES
4	OA" CHEL MANIMAY	
	24" SHELL MANWAY	GOOD CONDITION
2	4" COUPLING - INLET/OUTLET	GOOD CONDITION
3	4" COUPLING - SPARE NOZZLES	GOOD CONDITION
GL	GROUNDING LUG	GOOD CONDITION
Α	TANK ANCHORS	HAVE COATING FAILURE AT BOLTS
R1	4" COUPLING/2" FILL PIPING - ROOF	GOOD CONDITION
R2	4" COUPLING/2" LEVEL GAUGE PIPING	GOOD CONDITION
R3	24" ROOF MANWAY	LONG BOLT CONFIGURATION - NFPA 30 - GOOD
R4	4" COUPLING W/2" P/V VENT	MORRISON FIG. 548 2oz. 20,200 CFH @ 0.5psi
R5	4" COUPLING W/2" ALARM	GOOD CONDITION

D.W.W.

CHECKED BY:

D.E.C.

UNIT NUMBER: