

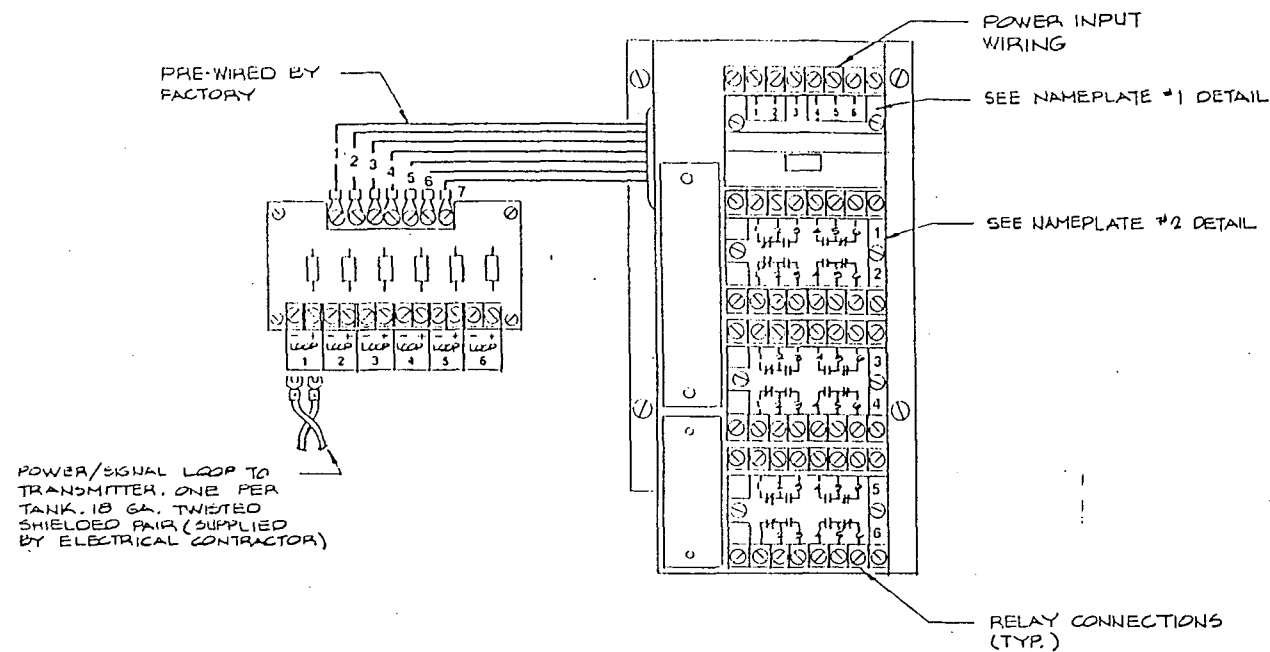


NAMEPLATE #1 DETAIL

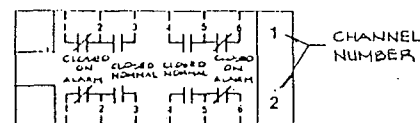

NAMEPLATE #2 DETAIL (TYP.)

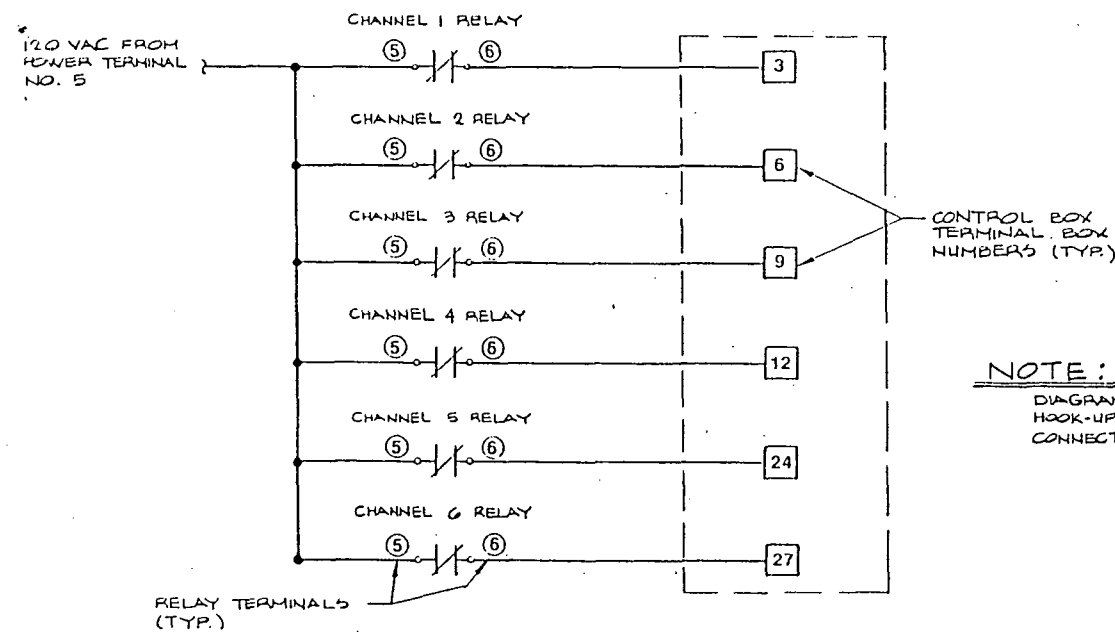

WIRING TO ALARM CONTROL BOX

NOTE:
DIAGRAM SHOWS 6 TANK
HOOK-UP. ONLY MAKE
CONNECTIONS FOR EXISTING TANKS.

EXISTING TANK PROBE LENGTH		
TANK DIAMETER	DISTANCE FROM TOP OF TANK TO 95% VOL. LEVEL	MINIMUM LENGTH OF PROBE INSIDE TANK
8' - 96"	9"	12"
10' - 120"	11"	14"
12' - 144"	14"	17"

FIGURE 6C

TITLE									
L.C.T. HIGH LEVEL ALARM RECIEVER SYSTEM DETAILS									
SAFETY-KLEEN CORP.									
777 BUI TIMBER ROAD • BLOOMSBURG, PA 17223 PHONE 717/607-8100									
SCALE	DRAWN	CHECKED	ENGINEERING APPR	OPERATION APPR	DATE				
NONE	ALS				1-10-8				
NO	DESCRIPTION	BY	CHK	APPR	DATE				

THIS DRAWING CONTAINS INFORMATION PROPRIETARY TO SAFETY-KLEEN CORP. ANY REPRODUCTION, DISCLOSURE OR USE OF THIS DRAWING IS EXPRESSLY PROHIBITED EXCEPT BY SAFETY-KLEEN OR AS SAFETY-KLEEN MAY AGREE IN WRITING.