



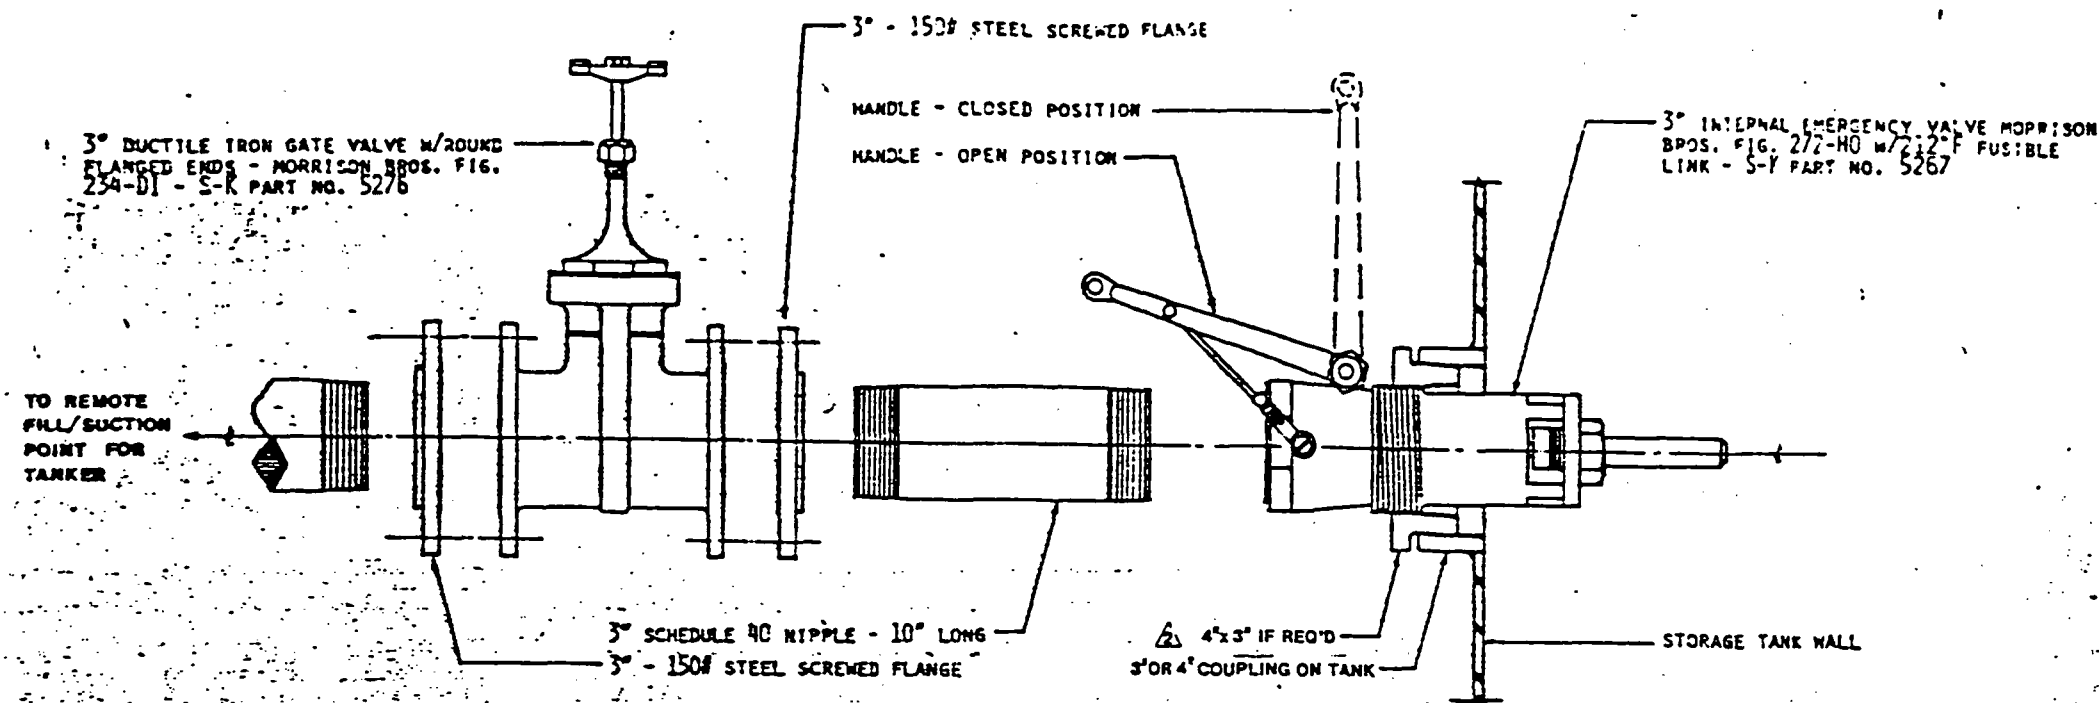

— STANDARD INSTALLATION FOR PIPING OF ALL STORAGE TANKS —

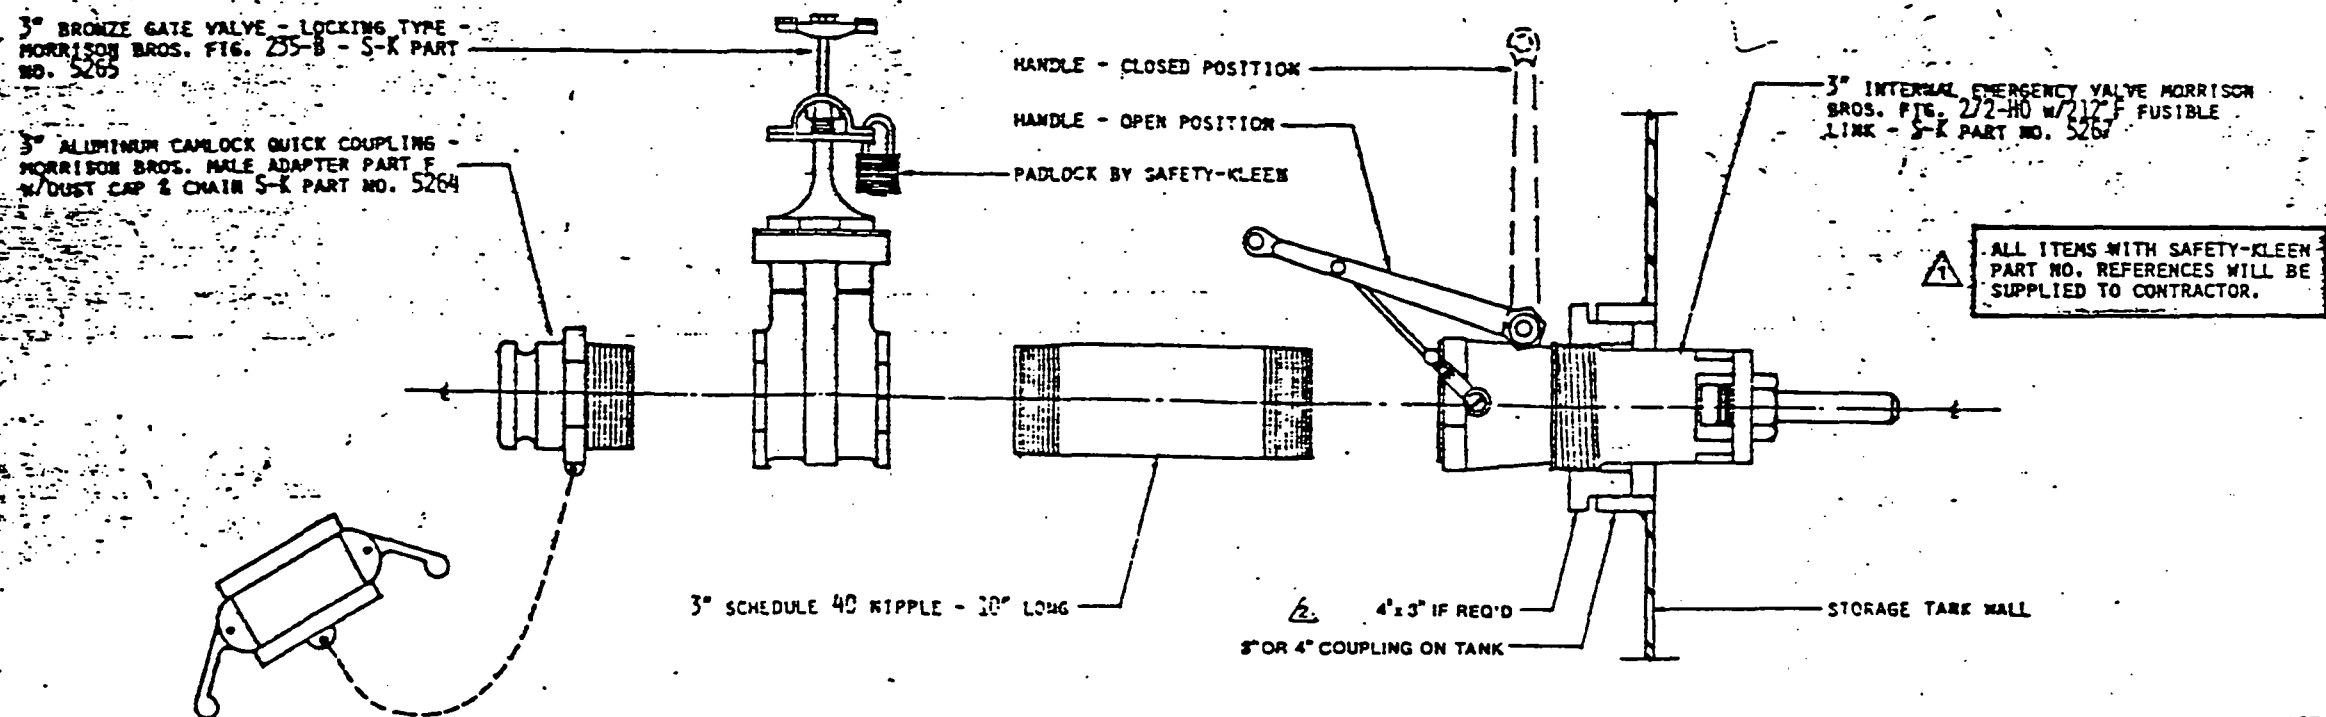

NOTE — THIS DRAWING SUPERCEDES SAFETY-KLEEN DRAWING C11036

— ADDITIONAL INSTALLATION FOR PIPING OF NEW TANKS FOR STORAGE OF USED SOLVENT —
(FOR LOCATIONS PRONE TO FREEZING ONLY - SEE SAFETY-KLEEN DRAWING D11124 —)

Safety-Kleen Corp.		PHONE 312-881-1100	
EMERGENCY & GATE VALVE INSTALLATION DETAILS		NO SCALE	
RD 3/24/86	WJ 12/22/84	FOR: SERVICE CENTER BRANCH	
BY		CONSTRUCTION & OR IMPROVEMENTS	
		C11302	

2	ADDED CLARIFICATION	RD	3/24/86
1	ADDED NOTE	WJ	12/22/84
REV	DESCRIPTION	BY	