
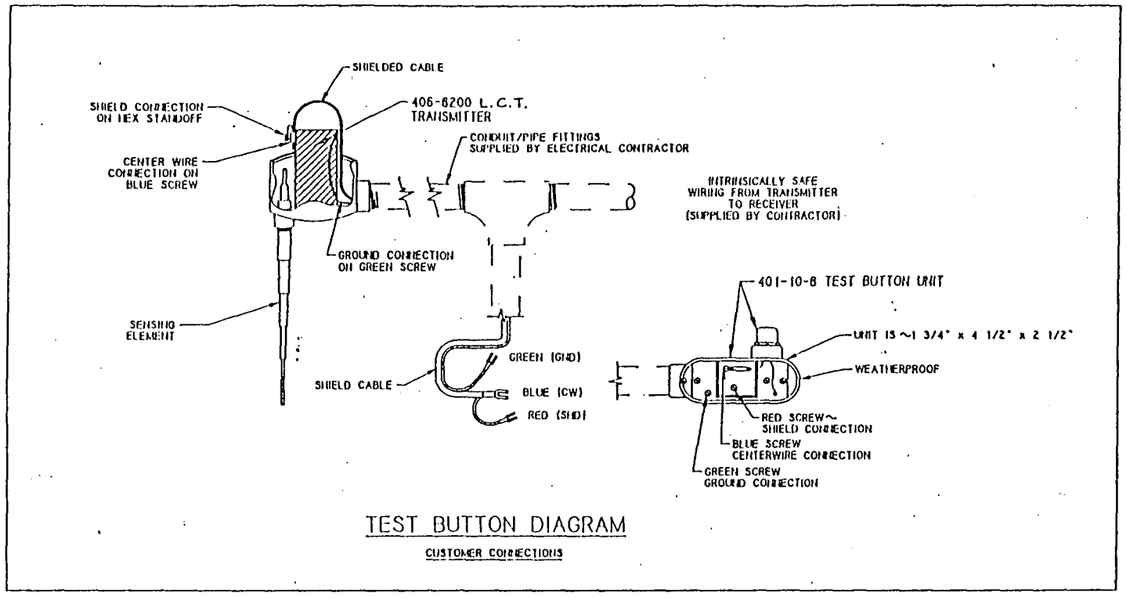


TEST BUTTON DIAGRAM

CUSTOMER CONNECTIONS

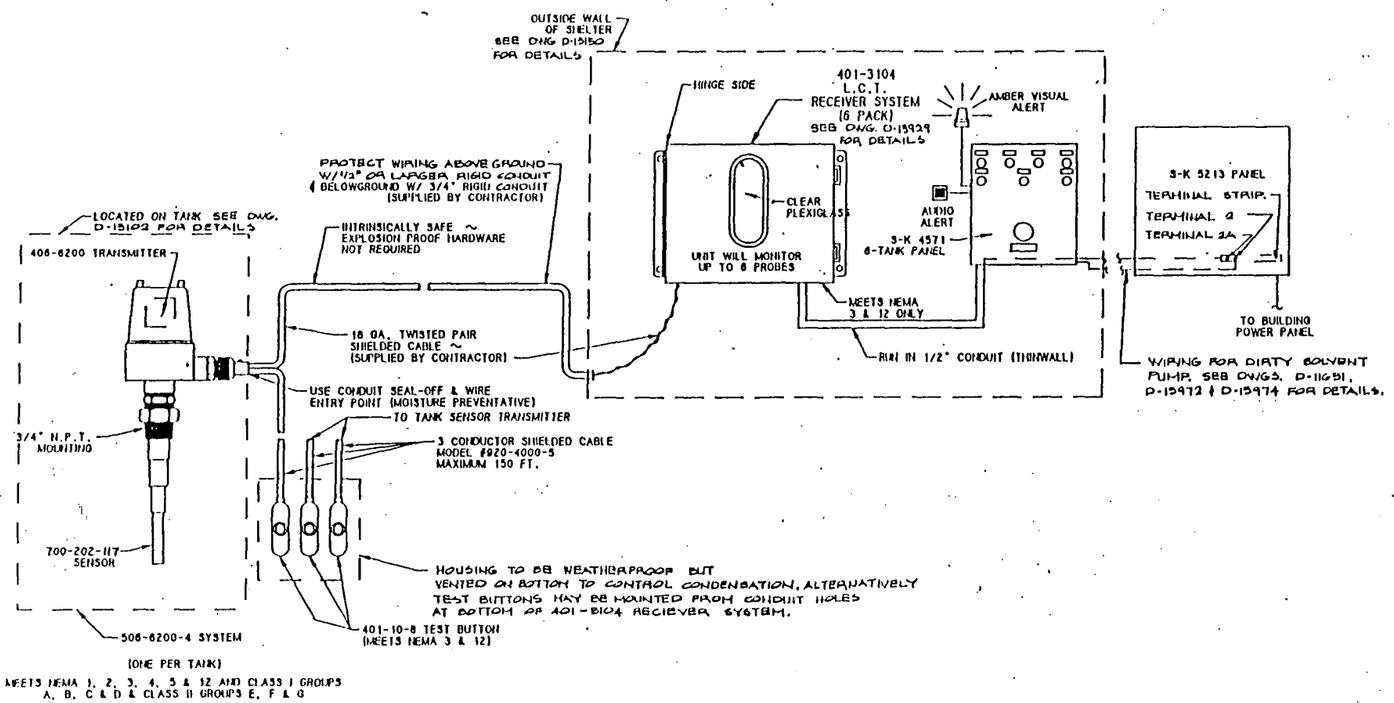

WIRING DIAGRAM OVERVIEW

NO SCALE

GENERAL NOTES:

1. DRAWING IS INTENDED TO SHOW A TYPICAL INSTALLATION ONLY... SEE ACTUAL SITE PLAN.
2. ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR VERIFICATION OF ACTUAL FIELD CONDITIONS.
3. ALL ITEMS SHOWN WITH A SAFETY-KLEEN PART NO. . THESE ITEMS WILL BE SUPPLIED BY S-K.
4. IF ANY FIELD MODIFICATIONS ARE REQUIRED, SAFETY-KLEEN BRANCH CONSTRUCTION GROUP IS TO BE NOTIFIED BEFORE PROCEEDING.
5. E.C. TO SUPPLY & INSTALL ALL RIGID CONDUIT, EMT & ANY NECESSARY LABOR & MATERIALS TO COMPLETE PROJECT.

THIS DOCUMENT HAS BEEN PREPARED AND IS APPROVED BY ME FOR INCLUSION IN ENVIRONMENTAL PERMIT APPLICATIONS ONLY. IT IS NEITHER APPROVED NOR IS IT TO BE USED FOR EQUIPMENT OR MATERIAL PROCUREMENT, CONSTRUCTION, OR ANY OTHER PURPOSE.

Figure II.C.2-5(d)

NO.	DESCRIPTION	BY	CHD	APPD	DATE
E	ADDED VARIOUS NOTATIONS	DS			1-12-[illegible]
D	REV'D. & REDRAWN ON COMP'TR.	TWD			8/30/[illegible]
C	ADDED TEST BUTTON UNIT	MA			7/31/[illegible]
B	ADDED SEALOFF FITTING	RD			10/17/[illegible]
A	REVISED & REDRAWN	RD			5/31/[illegible]

REVISIONS

TITLE: L.C.T. HIGH LEVEL ALARM ELECTRICAL DIAGRAM

SAFETY-KLEEN CORP.

PROJ. ENG. APPR.	DRAFTING APPR.	SCALE	DRAWN	DATE
		NONE	RD	5/12/[illegible]

DRAWING NO.