


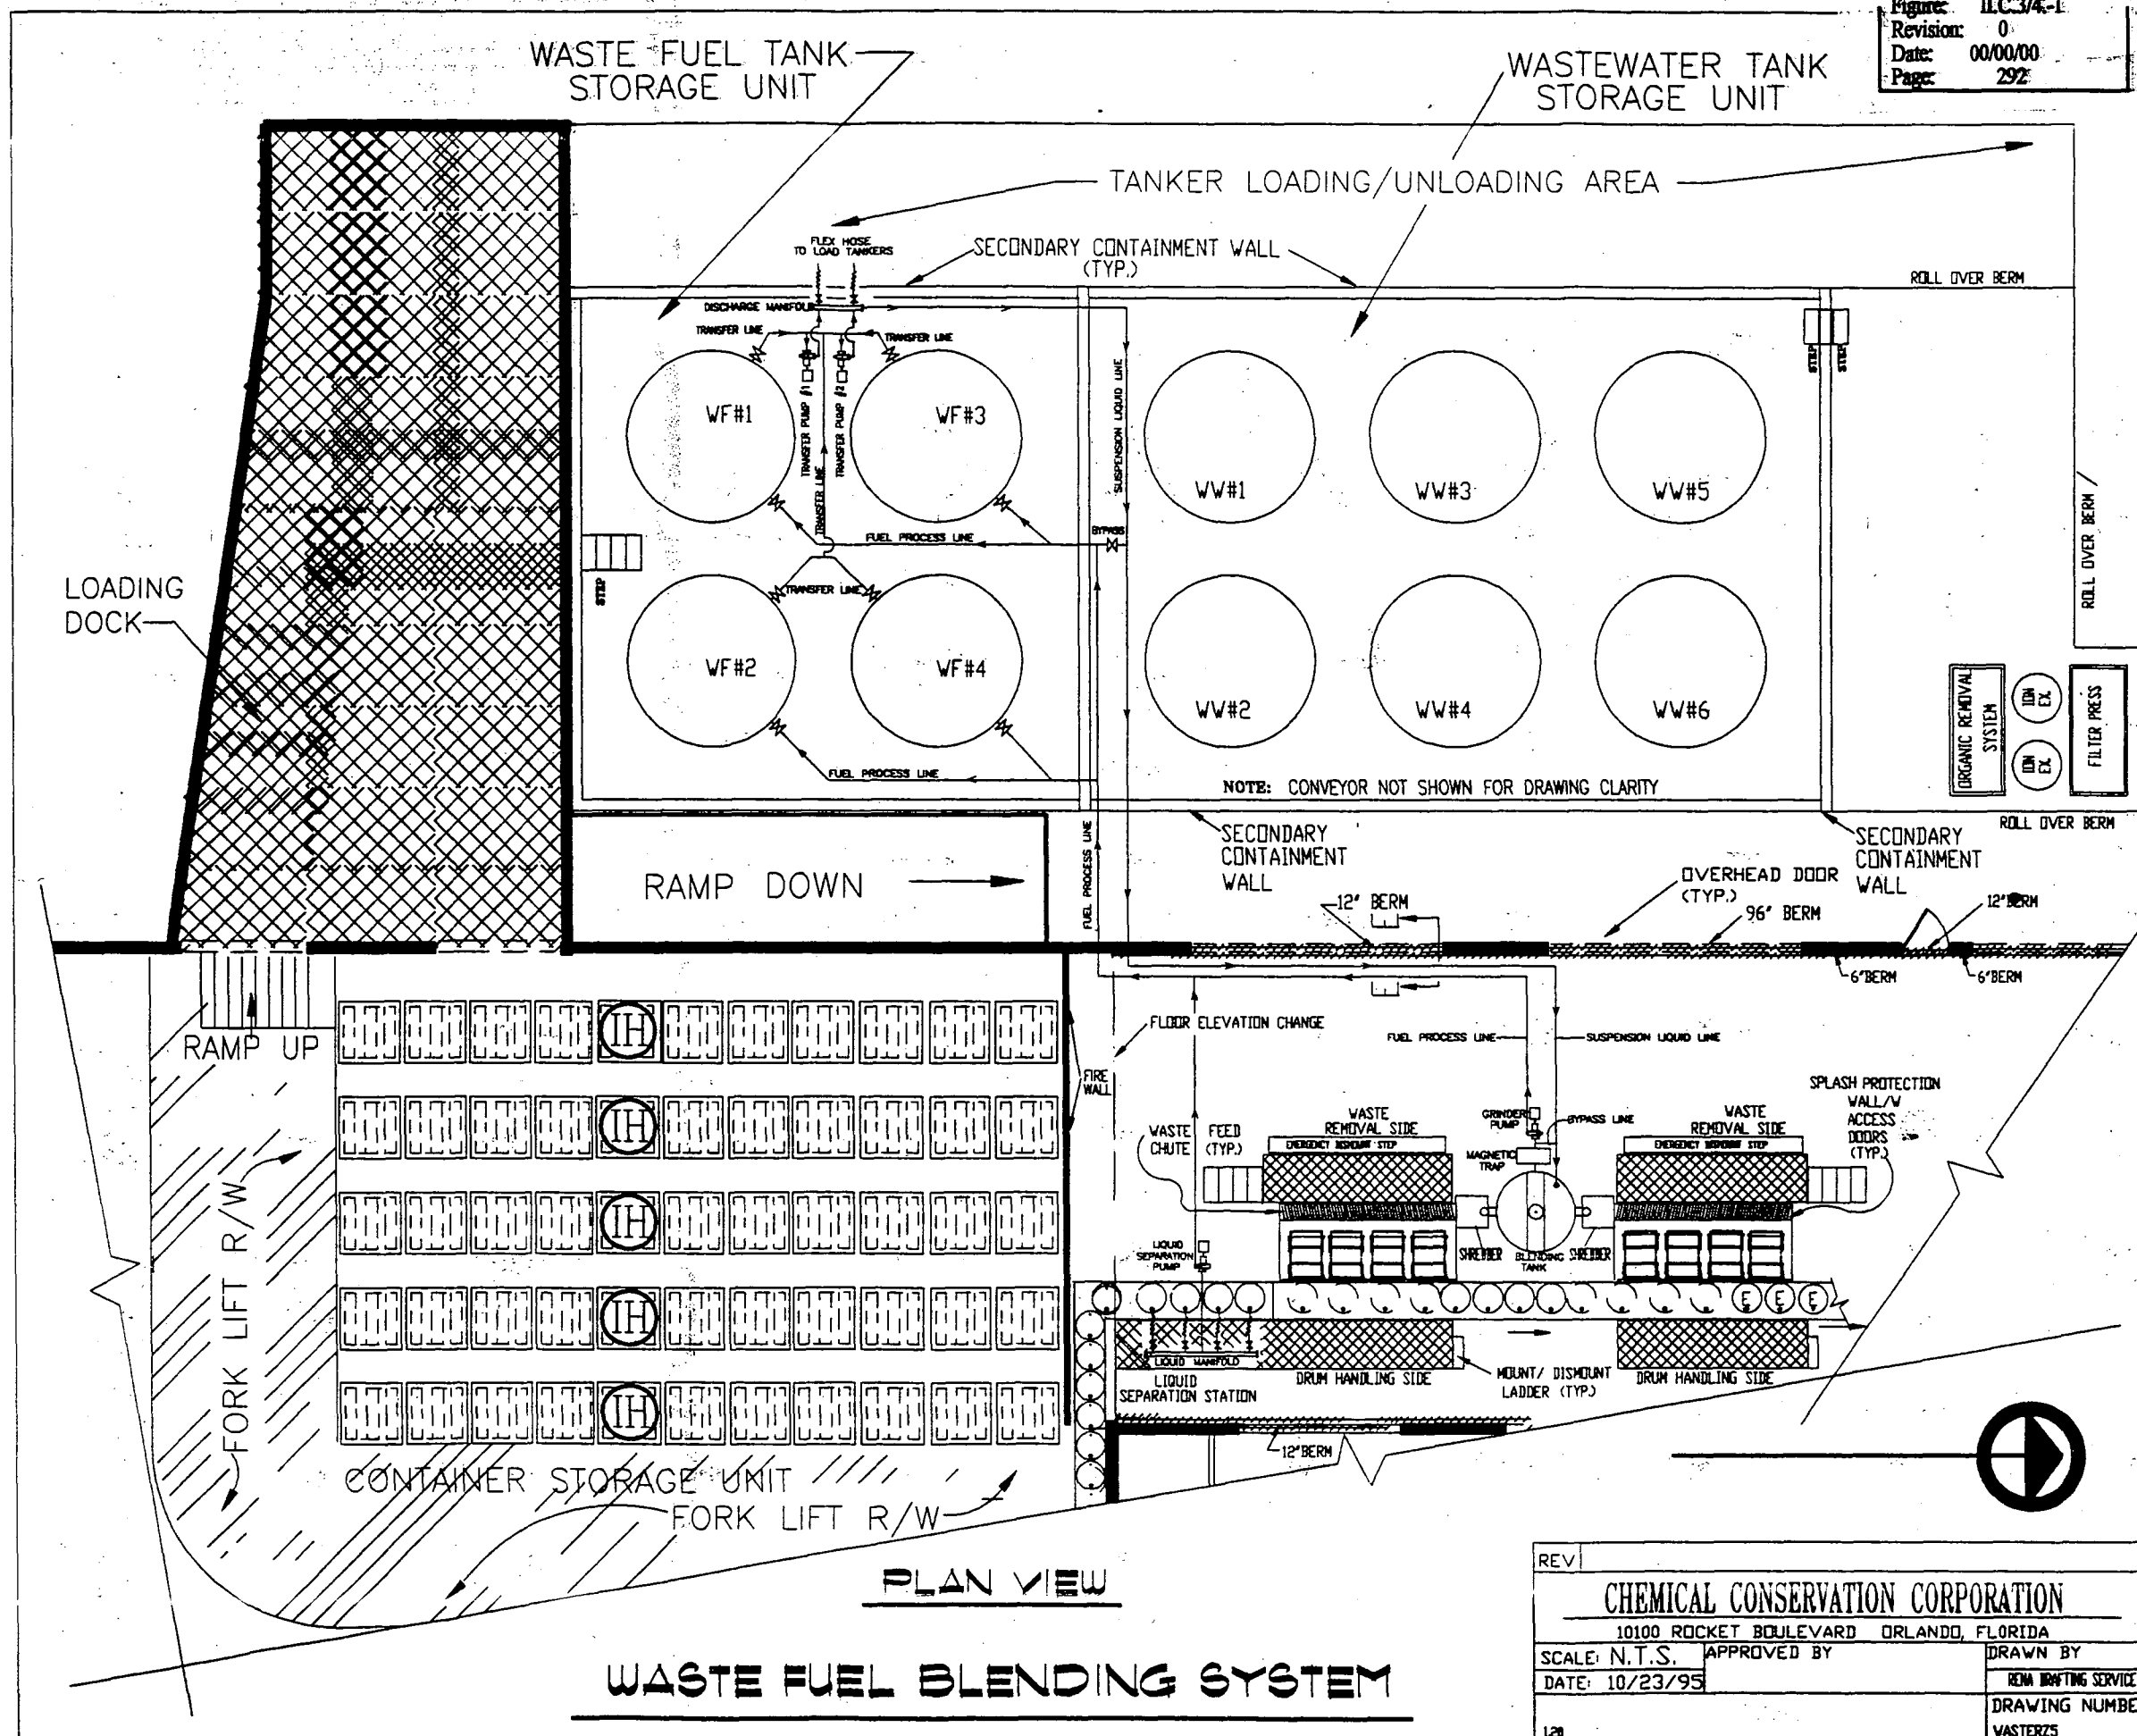


Figure: ILC 3/4-2
Revision: 0
Date: 00/00/00
Page: 293

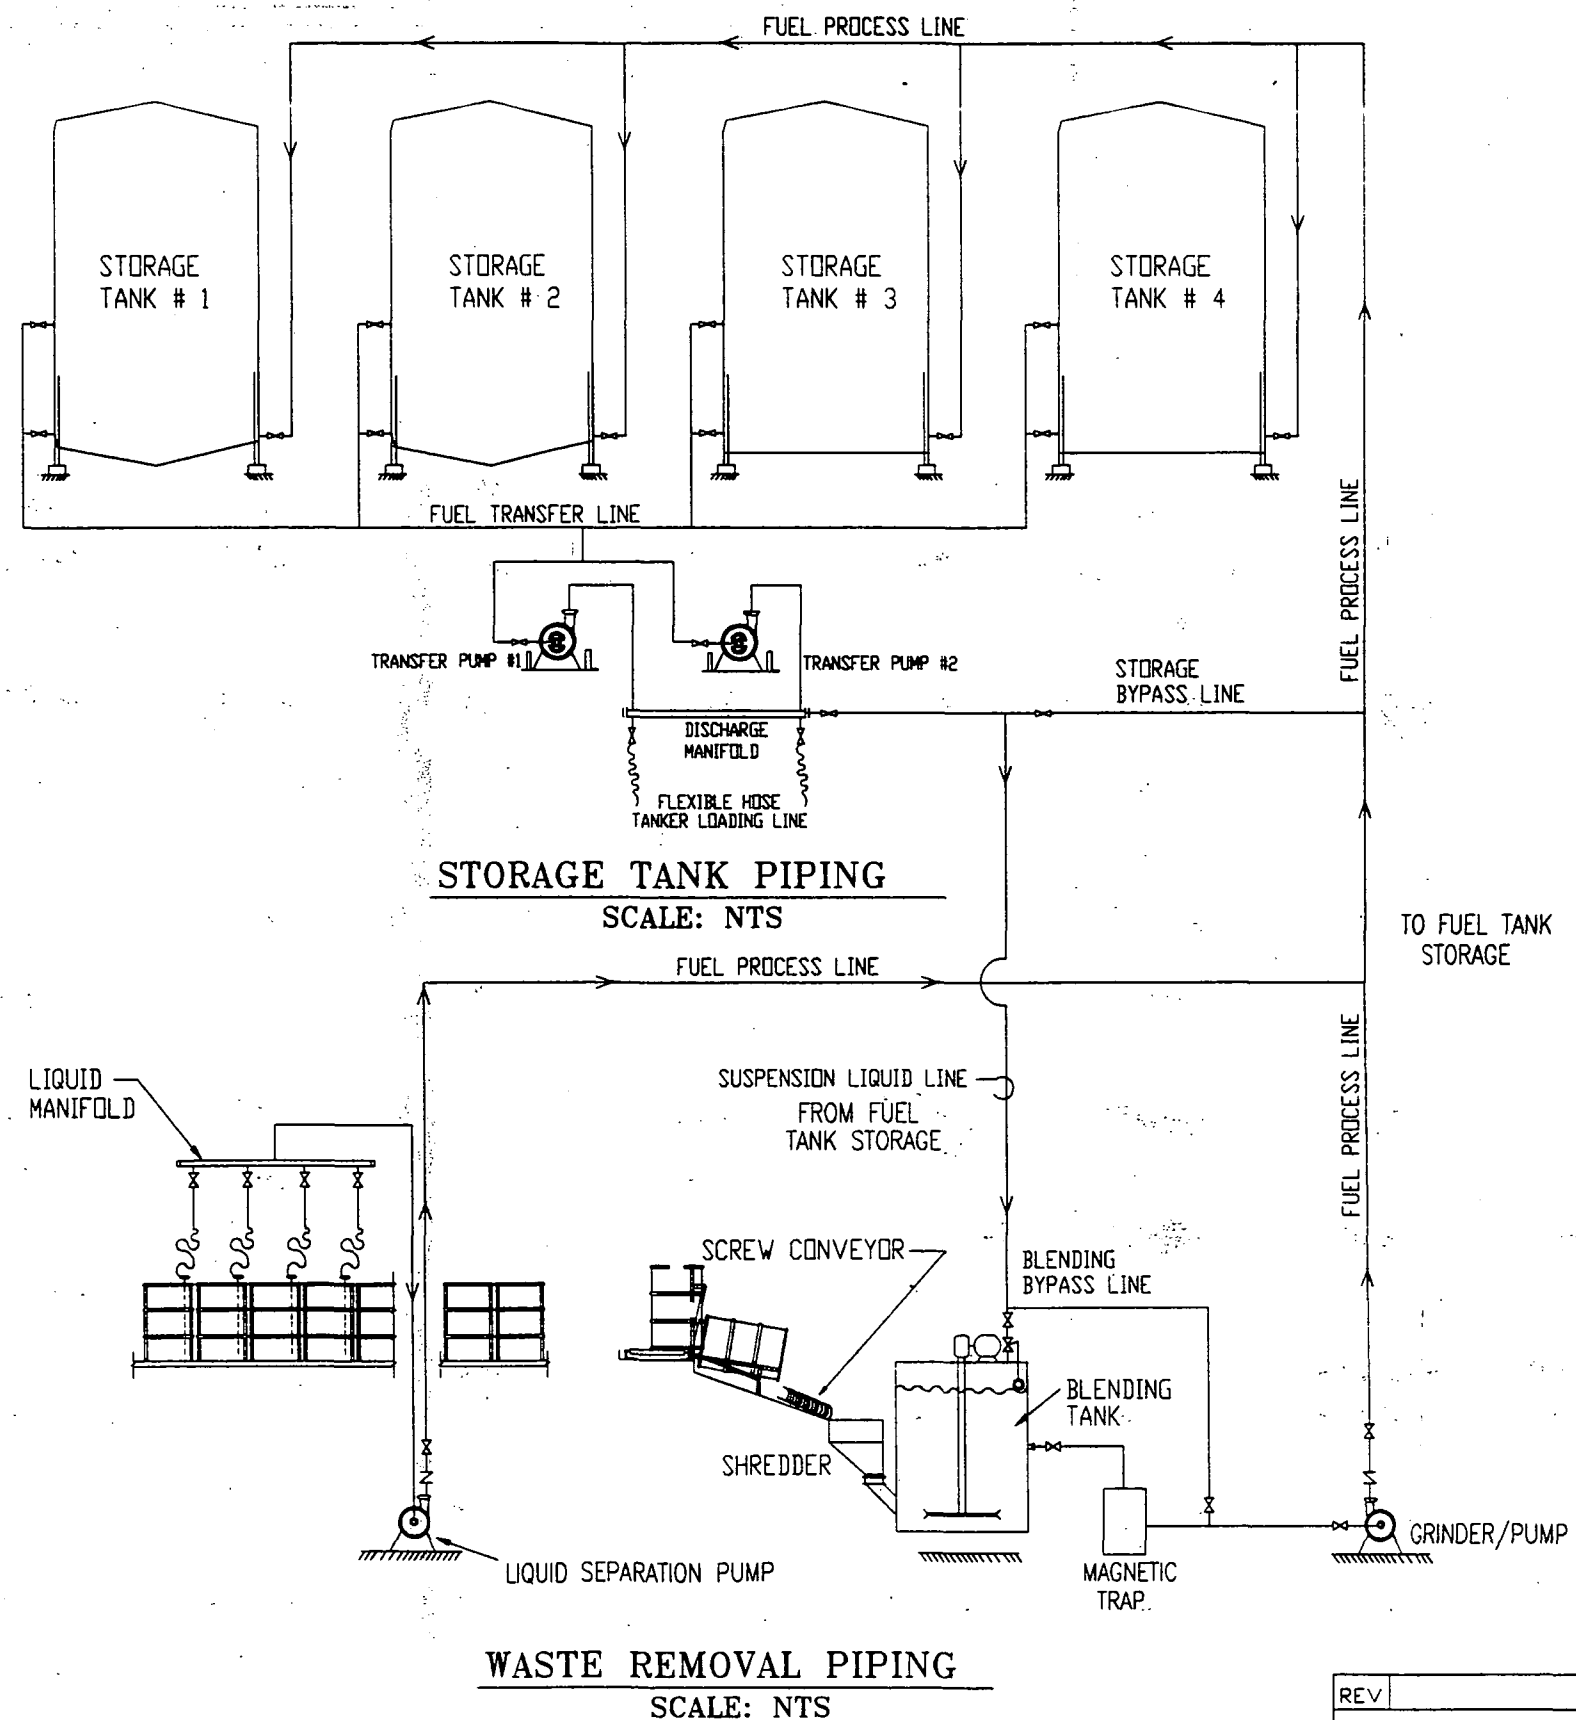


WASTE FUEL BLENDING SYSTEM PIPING DIAGRAM


REV			
CHEMICAL CONSERVATION CORPORATION			
10100 ROCKET BOULEVARD ORLANDO, FLORIDA			
SCALE: N.T.S.	APPROVED BY		DRAWN BY
DATE: 10/22/95			RENA DRAFTING SERVICE
			DRAWING NUMBER
120			WAFBSYZS

WASTE REMOVAL STATION DETAIL


Figure ILC 3/4-3
Revision 0
Date 00/00/00
Page 294

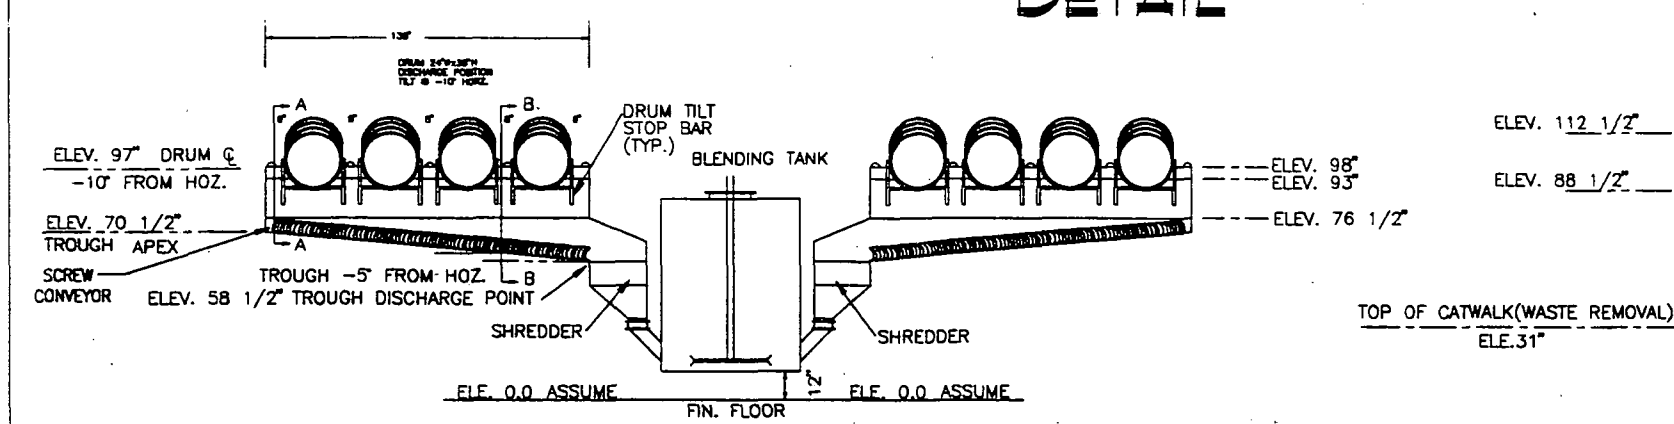


ELEVATION "C-C"
SCALE: 1/4"=1'-0"

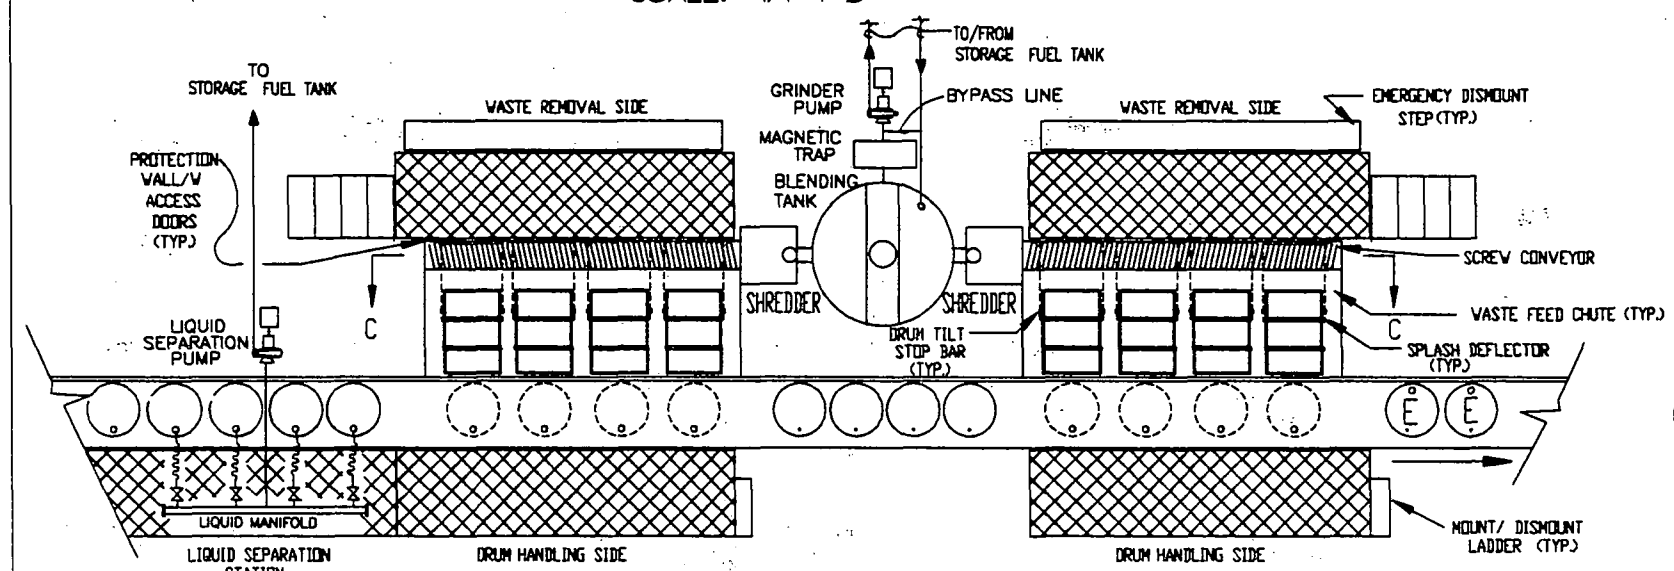


PLAN
SCALE: 1/4"=1'-0"

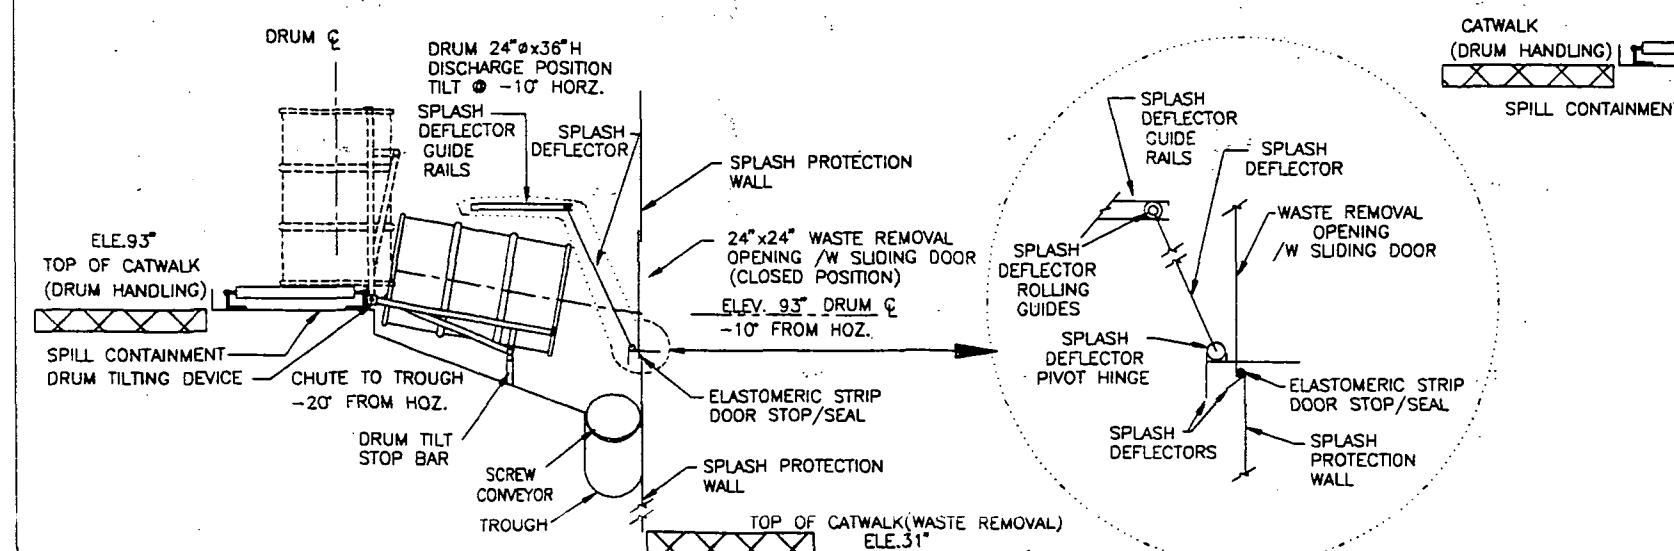

SECTION A-A
SCALE: 1/2"=1'-0"

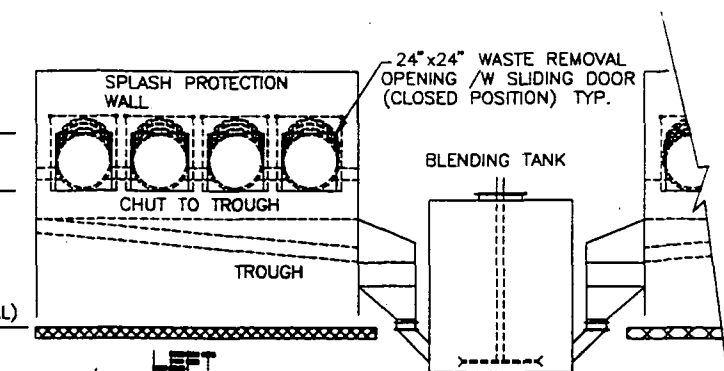


LEFT

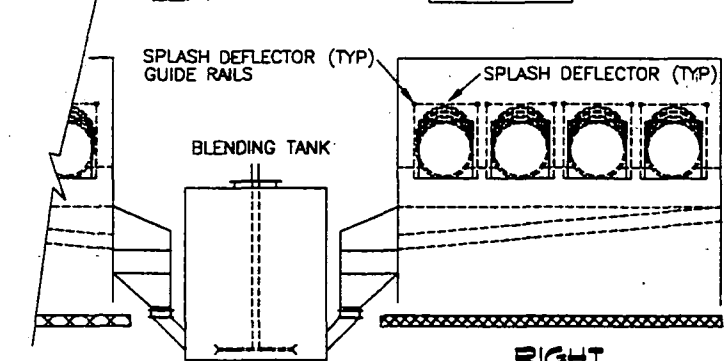

RIGHT

EAST ELEVATION
SCALE: 1/4"=1'-0"

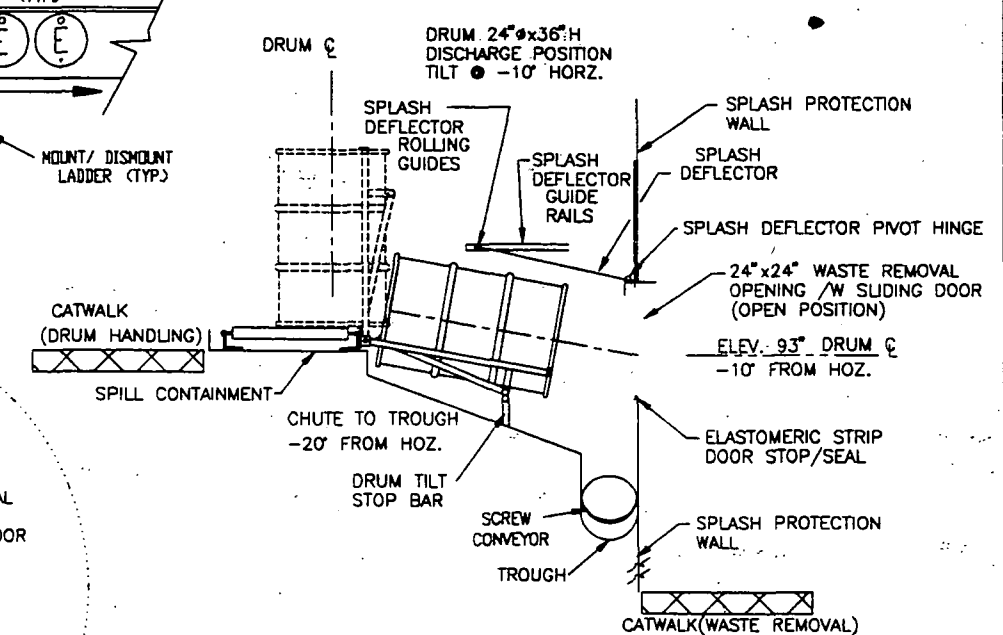

SECTION B-B
SCALE: 1/2"=1'-0"


REV			
CHEMICAL CONSERVATION CORPORATION			
10100 ROCKET BOULEVARD ORLANDO, FLORIDA			
SCALE: AS NOTED	APPROVED BY	DRAWN BY	
DATE: 10/31/95		RENA DRAFTING SERVICE	
		DRAWING NUMBER	
		WASDET25	

WASTEWATER TREATMENT SYSTEM - PLAN VIEW

Figure: ILC.3/4-4
Revision: 0
Date: 00/00/00
Page: 298

LEGEND


1. CORROSIVE LIQUID LINE (LISTED)
2. CORROSIVE LIQUID LINE (CHARACTERISTIC)
3. WASTEWATER LINE (LISTED)
4. WASTEWATER LINE (CHARACTERISTIC)
5. CORROSIVE LIQUID PUMP
6. WASTEWATER PUMP
7. CORROSIVE LIQUID TANK (LISTED)
8. CORROSIVE LIQUID TANK (CHARACTERISTIC)
9. WASTEWATER TANK (LISTED)
10. WASTEWATER TANK (CHARACTERISTIC)
11. PROCESS TANK (HAZARDOUS)
12. PROCESS TANK (NON-HAZARDOUS)
13. CORROSIVE LIQUID TRANSFER PUMP
14. WASTEWATER TRANSFER PUMP
15. CORROSIVE LIQUID TRANSFER LINE
16. WASTEWATER TRANSFER LINE
17. TREATMENT TANK (REACTOR) #1
18. TREATMENT TANK (REACTOR) #2
19. TREATMENT PUMP #1
20. TREATMENT PUMP #2
21. TREATMENT LINE
22. FILTER PRESS
23. CONNECTION LINE
24. ORGANIC REMOVAL SYSTEM
25. PROCESS LINE
26. WASTEWATER RETURN LINE
27. PROCESS RECIRCULATION LINE
28. WASTEWATER RECIRCULATION LINE
29. HAZARDOUS PROCESS PUMP
30. NON-HAZARDOUS PROCESS PUMP
31. PROCESS BY-PASS LINE
32. CORROSIVE LIQUID FILTER
33. WASTEWATER FILTER
34. ION EXCHANGE TOWERS

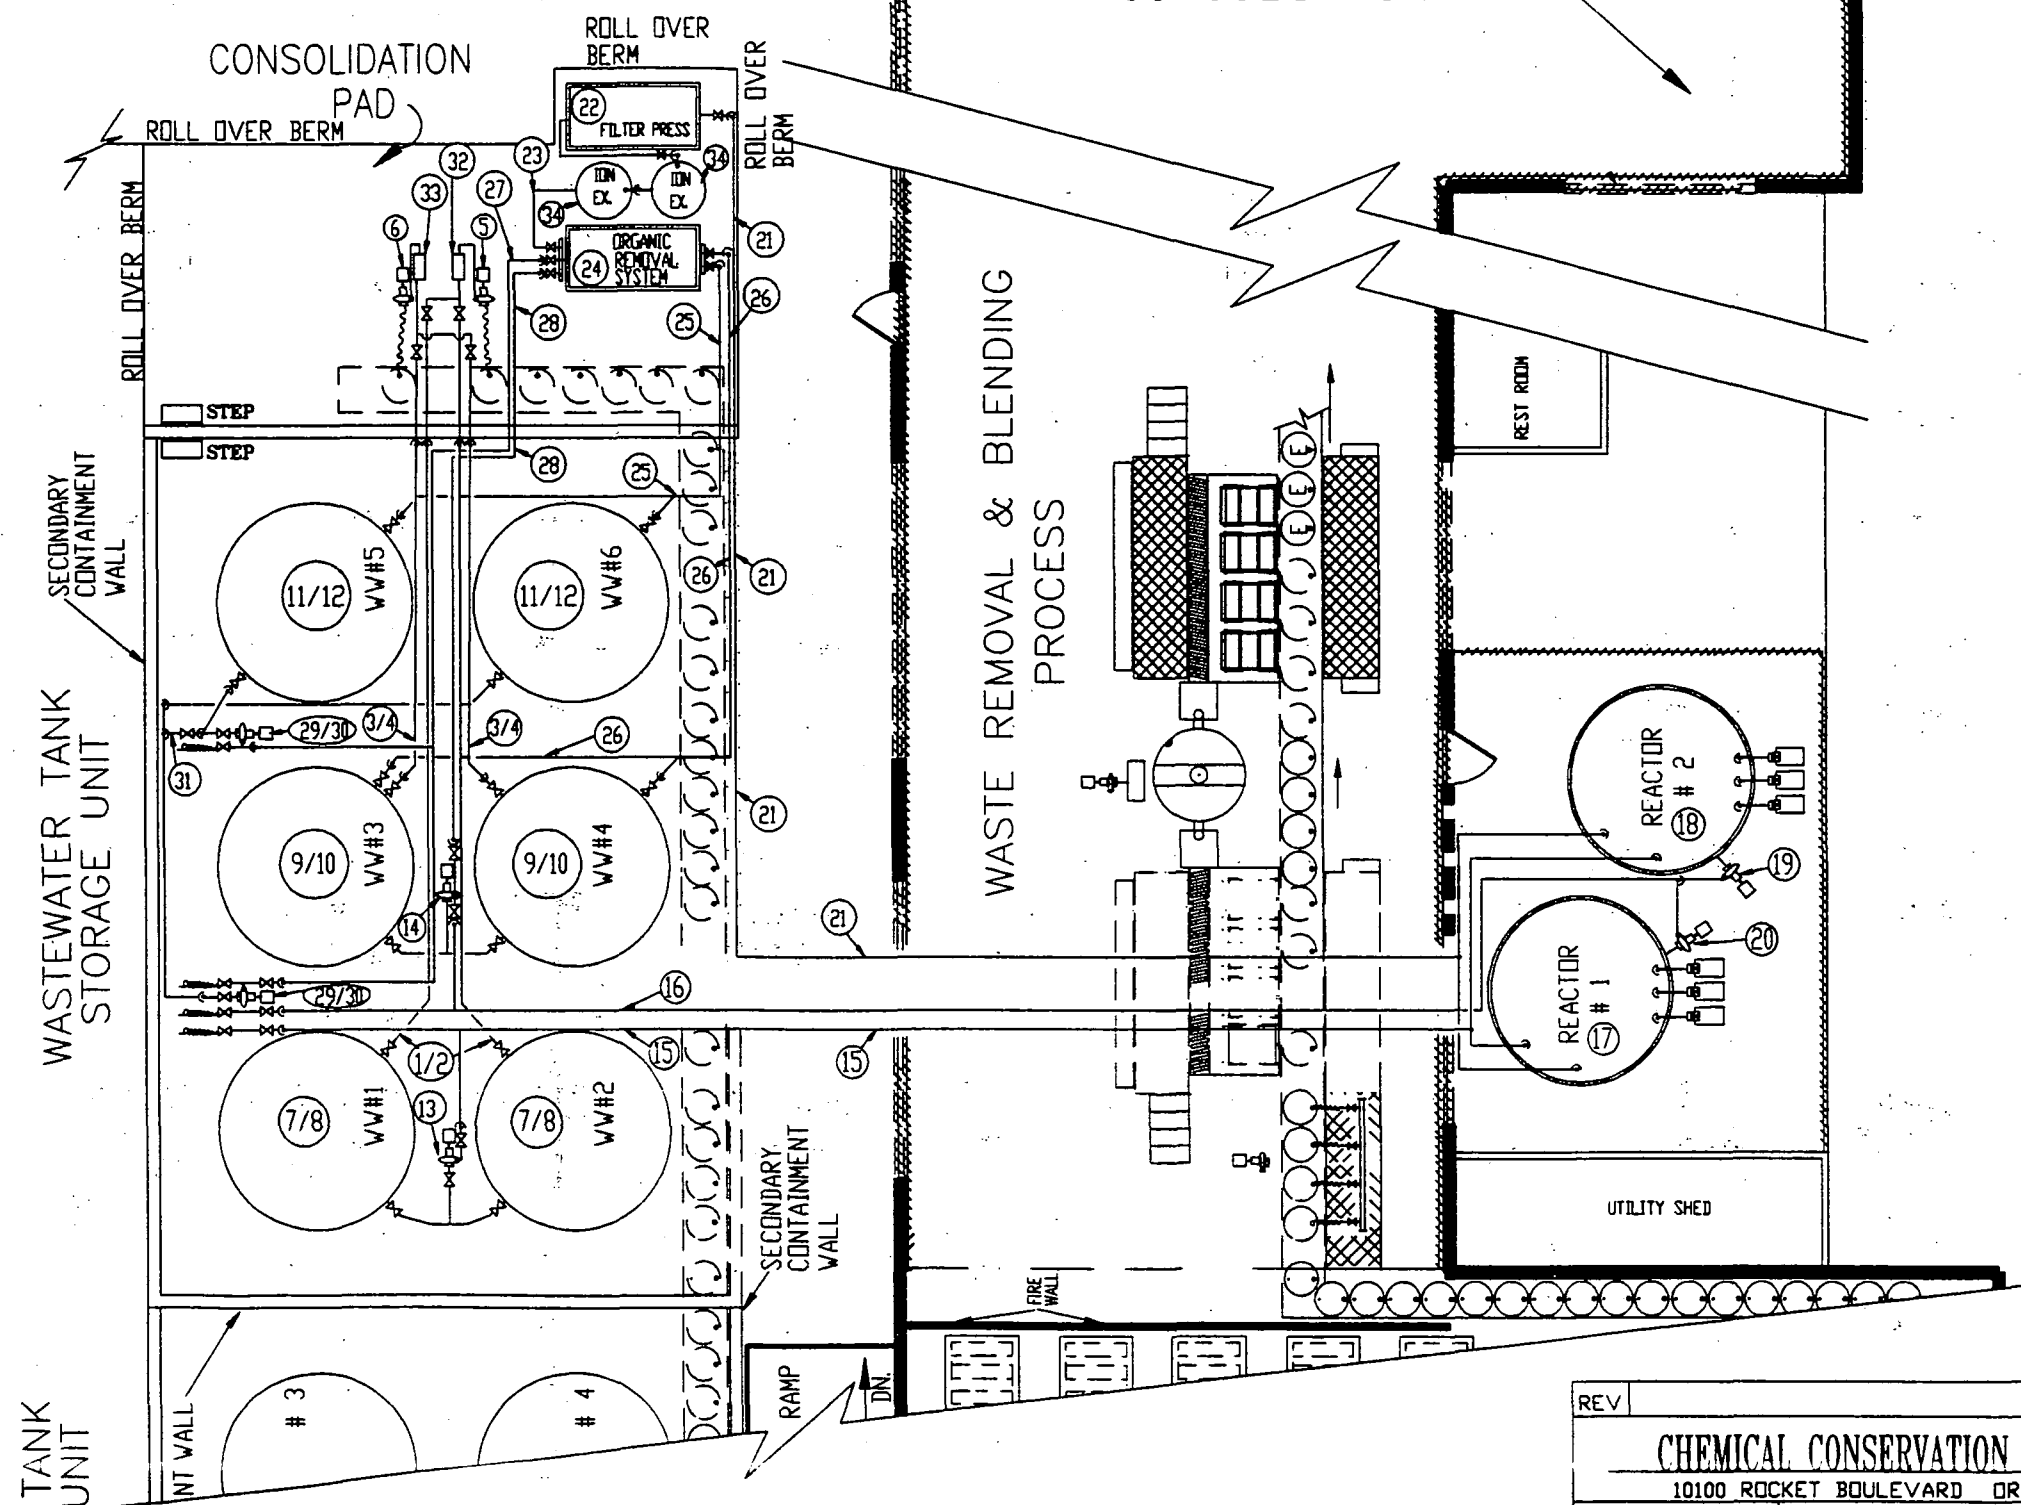

REV		
CHEMICAL CONSERVATION CORPORATION		
10100 ROCKET BOULEVARD ORLANDO, FLORIDA		
SCALE: N.T.S.	APPROVED BY	DRAWN BY
DATE: 10/26/95		REDA DRAFTING SERVICE
		DRAWING NUMBER
		VATPIP25

WASTEWATER TREATMENT SYSTEM PIPING DIAGRAM

Figure: ILC3/4-5
Revision: 0
Date: 00/00/00
Page: 299

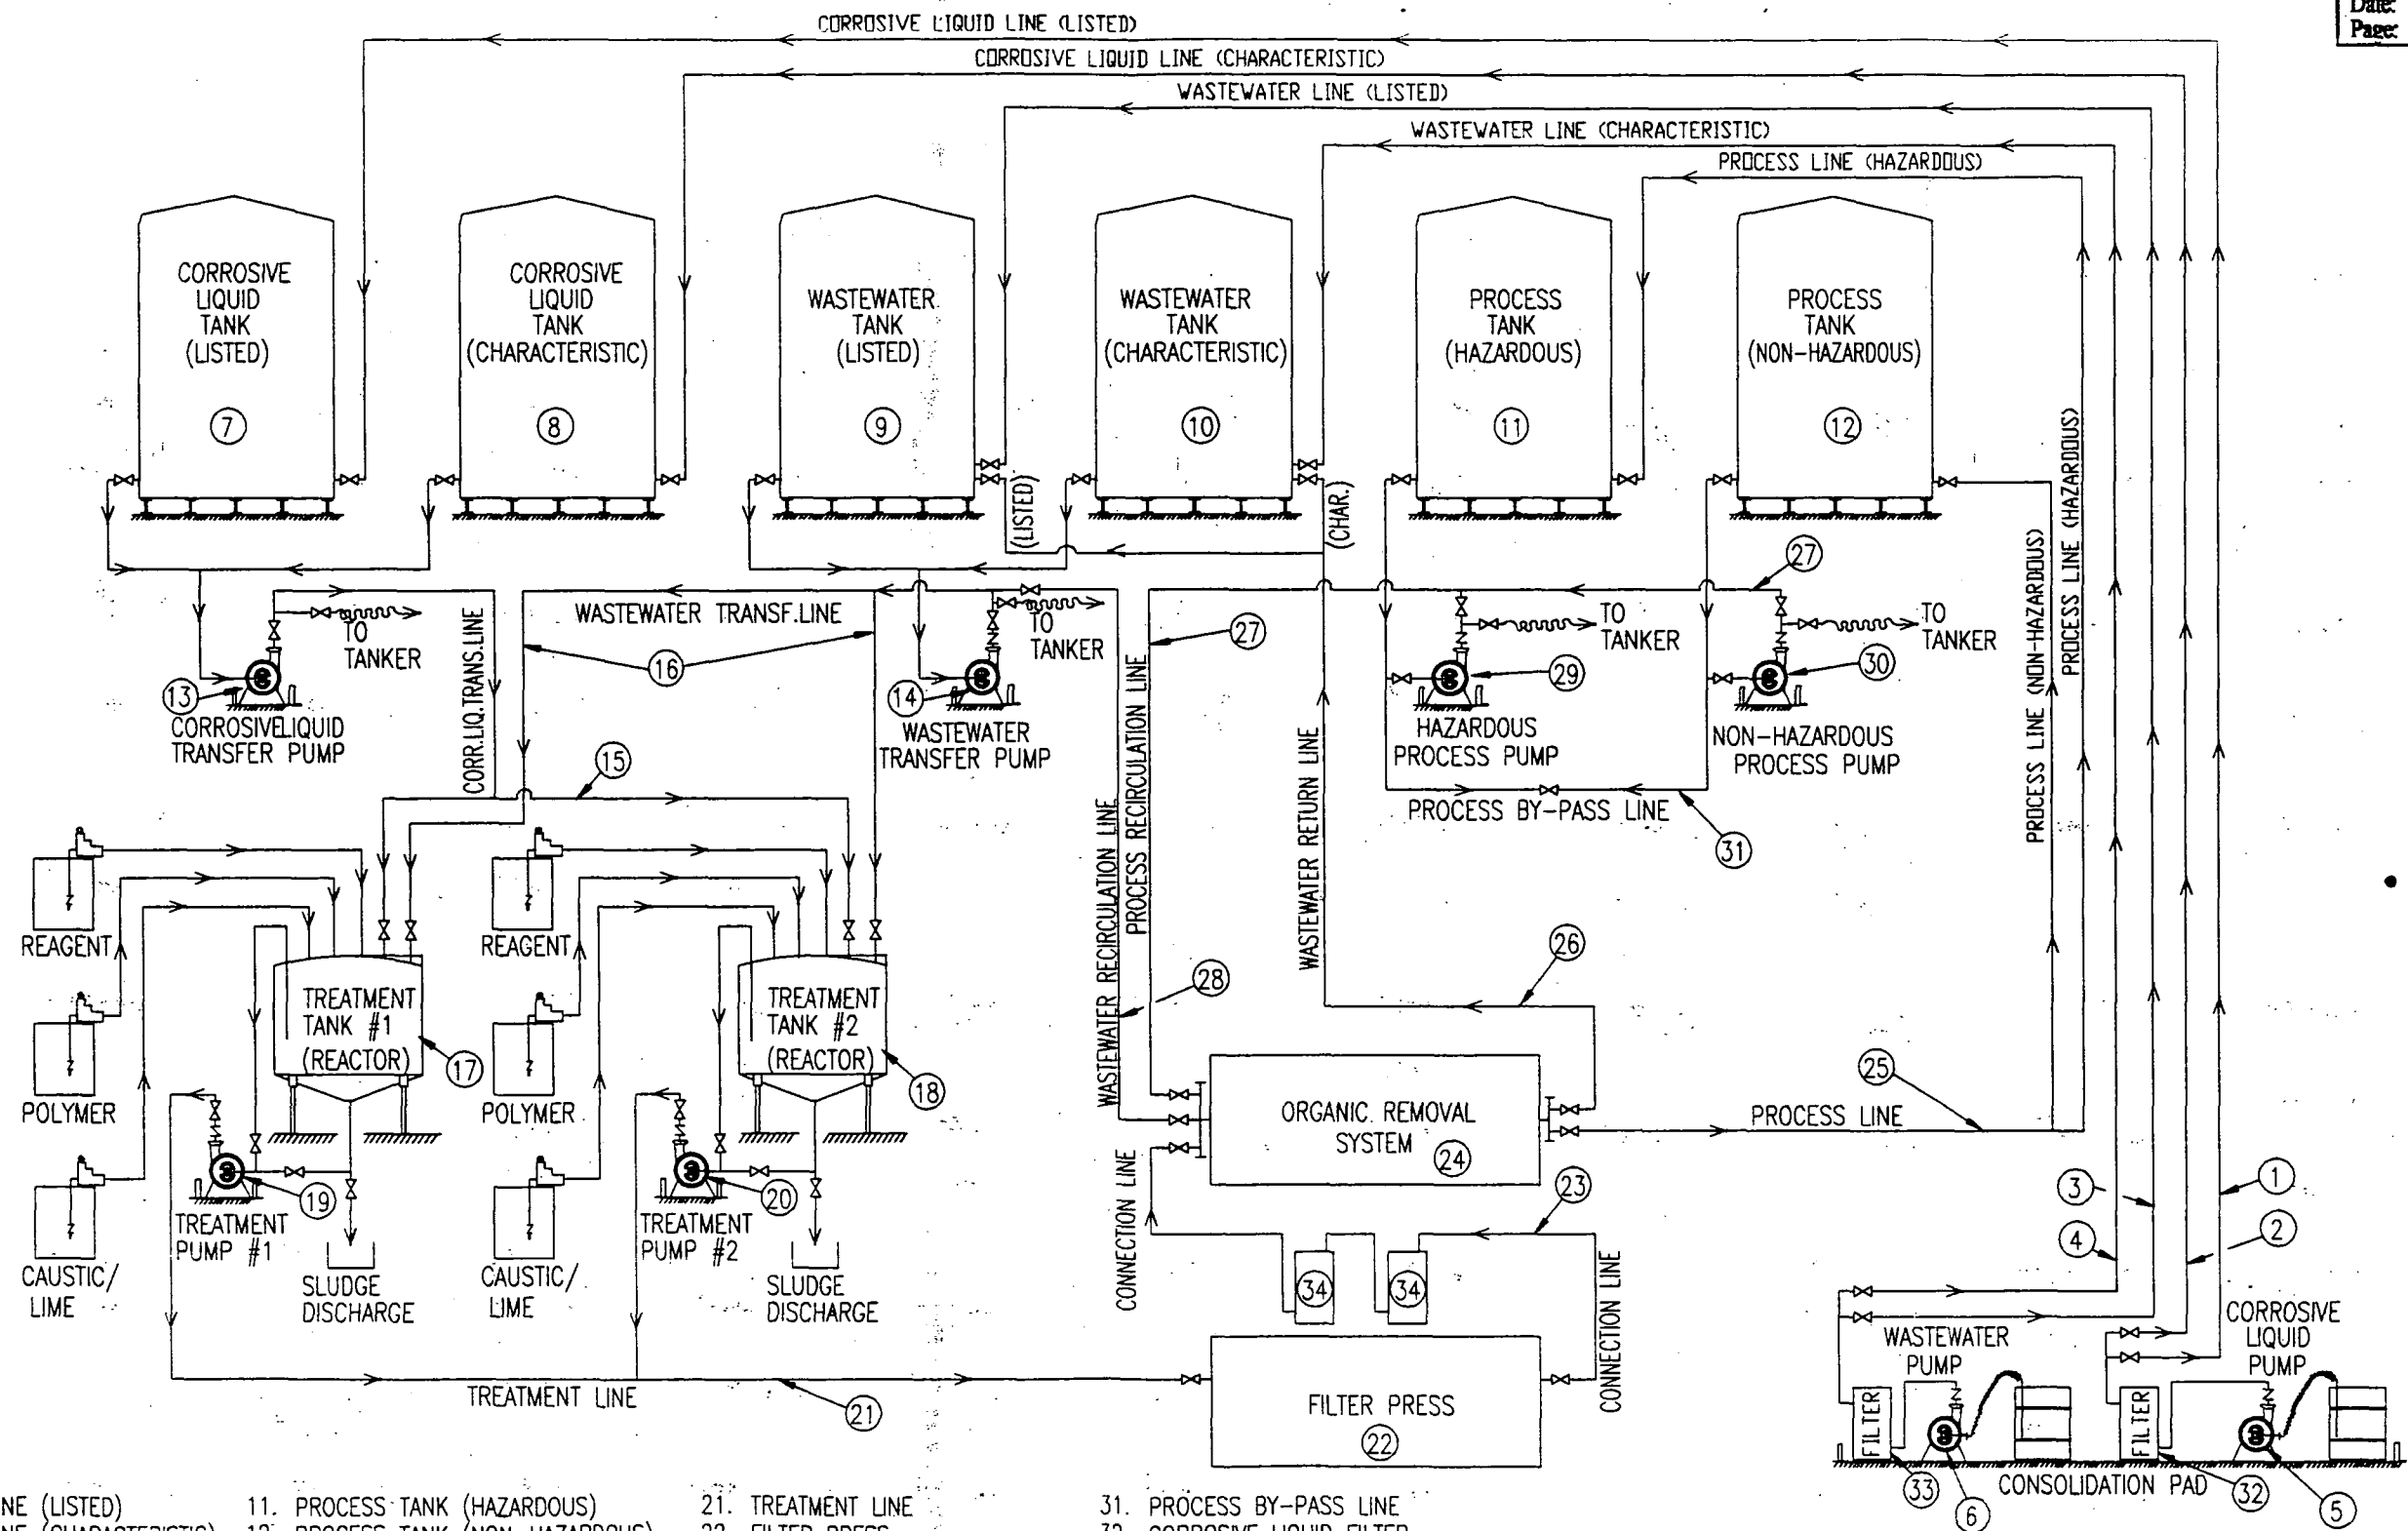

LEGEND

- | | | | |
|---|------------------------------------|-----------------------------------|-----------------------------|
| 1. CORROSIVE LIQUID LINE (LISTED) | 11. PROCESS TANK (HAZARDOUS) | 21. TREATMENT LINE | 31. PROCESS BY-PASS LINE |
| 2. CORROSIVE LIQUID LINE (CHARACTERISTIC) | 12. PROCESS TANK (NON-HAZARDOUS) | 22. FILTER PRESS | 32. CORROSIVE LIQUID FILTER |
| 3. WASTEWATER LINE (LISTED) | 13. CORROSIVE LIQUID TRANSFER PUMP | 23. CONNECTION LINE | 33. WASTEWATER FILTER |
| 4. WASTEWATER LINE (CHARACTERISTIC) | 14. WASTEWATER TRANSFER PUMP | 24. ORGANIC REMOVAL SYSTEM | 34. ION EXCHANGE TOWERS |
| 5. CORROSIVE LIQUID PUMP | 15. CORROSIVE LIQUID TRANSFER LINE | 25. PROCESS LINE | |
| 6. WASTEWATER PUMP | 16. WASTEWATER TRANSFER LINE | 26. WASTEWATER RETURN LINE | |
| 7. CORROSIVE LIQUID TANK (LISTED) | 17. TREATMENT TANK (REACTOR) #1 | 27. PROCESS RECIRCULATION LINE | |
| 8. CORROSIVE LIQUID TANK (CHARACTERISTIC) | 18. TREATMENT TANK (REACTOR) #2 | 28. WASTEWATER RECIRCULATION LINE | |
| 9. WASTEWATER TANK (LISTED) | 19. TREATMENT PUMP #1 | 29. HAZARDOUS PROCESS PUMP | |
| 10. WASTEWATER TANK (CHARACTERISTIC) | 20. TREATMENT PUMP #2 | 30. NON-HAZARDOUS PROCESS PUMP | |

REV			
CHEMICAL CONSERVATION CORPORATION			
10100 ROCKET BOULEVARD ORLANDO, FLORIDA			
SCALE: N.T.S.	APPROVED BY		DRAWN BY
DATE: 10-26-95			REMA DRAFTING SERVICE
			DRAWING NUMBER
			VTRSYS25 COS 141-1