



January 8, 1993

Dept. of Environmental Reg. SENT VIA FEDERAL EXPRESS
West Palm Beach MAIL - January 8, 1993
AirBill 6097235152

Mr. Vic Kamath, P.E..
Hazardous Waste Section
Florida Department of
Environmental Regulation
Southeast District
1900 South Congress Avenue, Suite A
West Palm Beach, Florida 33406

JAN 15 1993

HAZARDOUS WASTE
PERMITTING

RE: Safety-Kleen, Corp., Medley FLD 984 171 694
Operating Permit HO13-216311
Subpart BB Piping and Valve Schematic


Dear Mr Kamath:

Enclosed are three copies of the environmental piping schematic for the waste mineral spirits and waste antifreeze tanks in the application for permit HO13-216311 for the referenced facility. This page should replace the page currently in the application.

The submittal of this schematic fulfills a commitment made to Knox McKee in a letter dated December 22, 1992.


Please contact me at (813)682-8094 should you have any questions.

Sincerely,


Victor L. San Agustin, P.E.
Regional Environmental Manager
Tampa Region

Enclosure

c: C. Norton - ERM, South

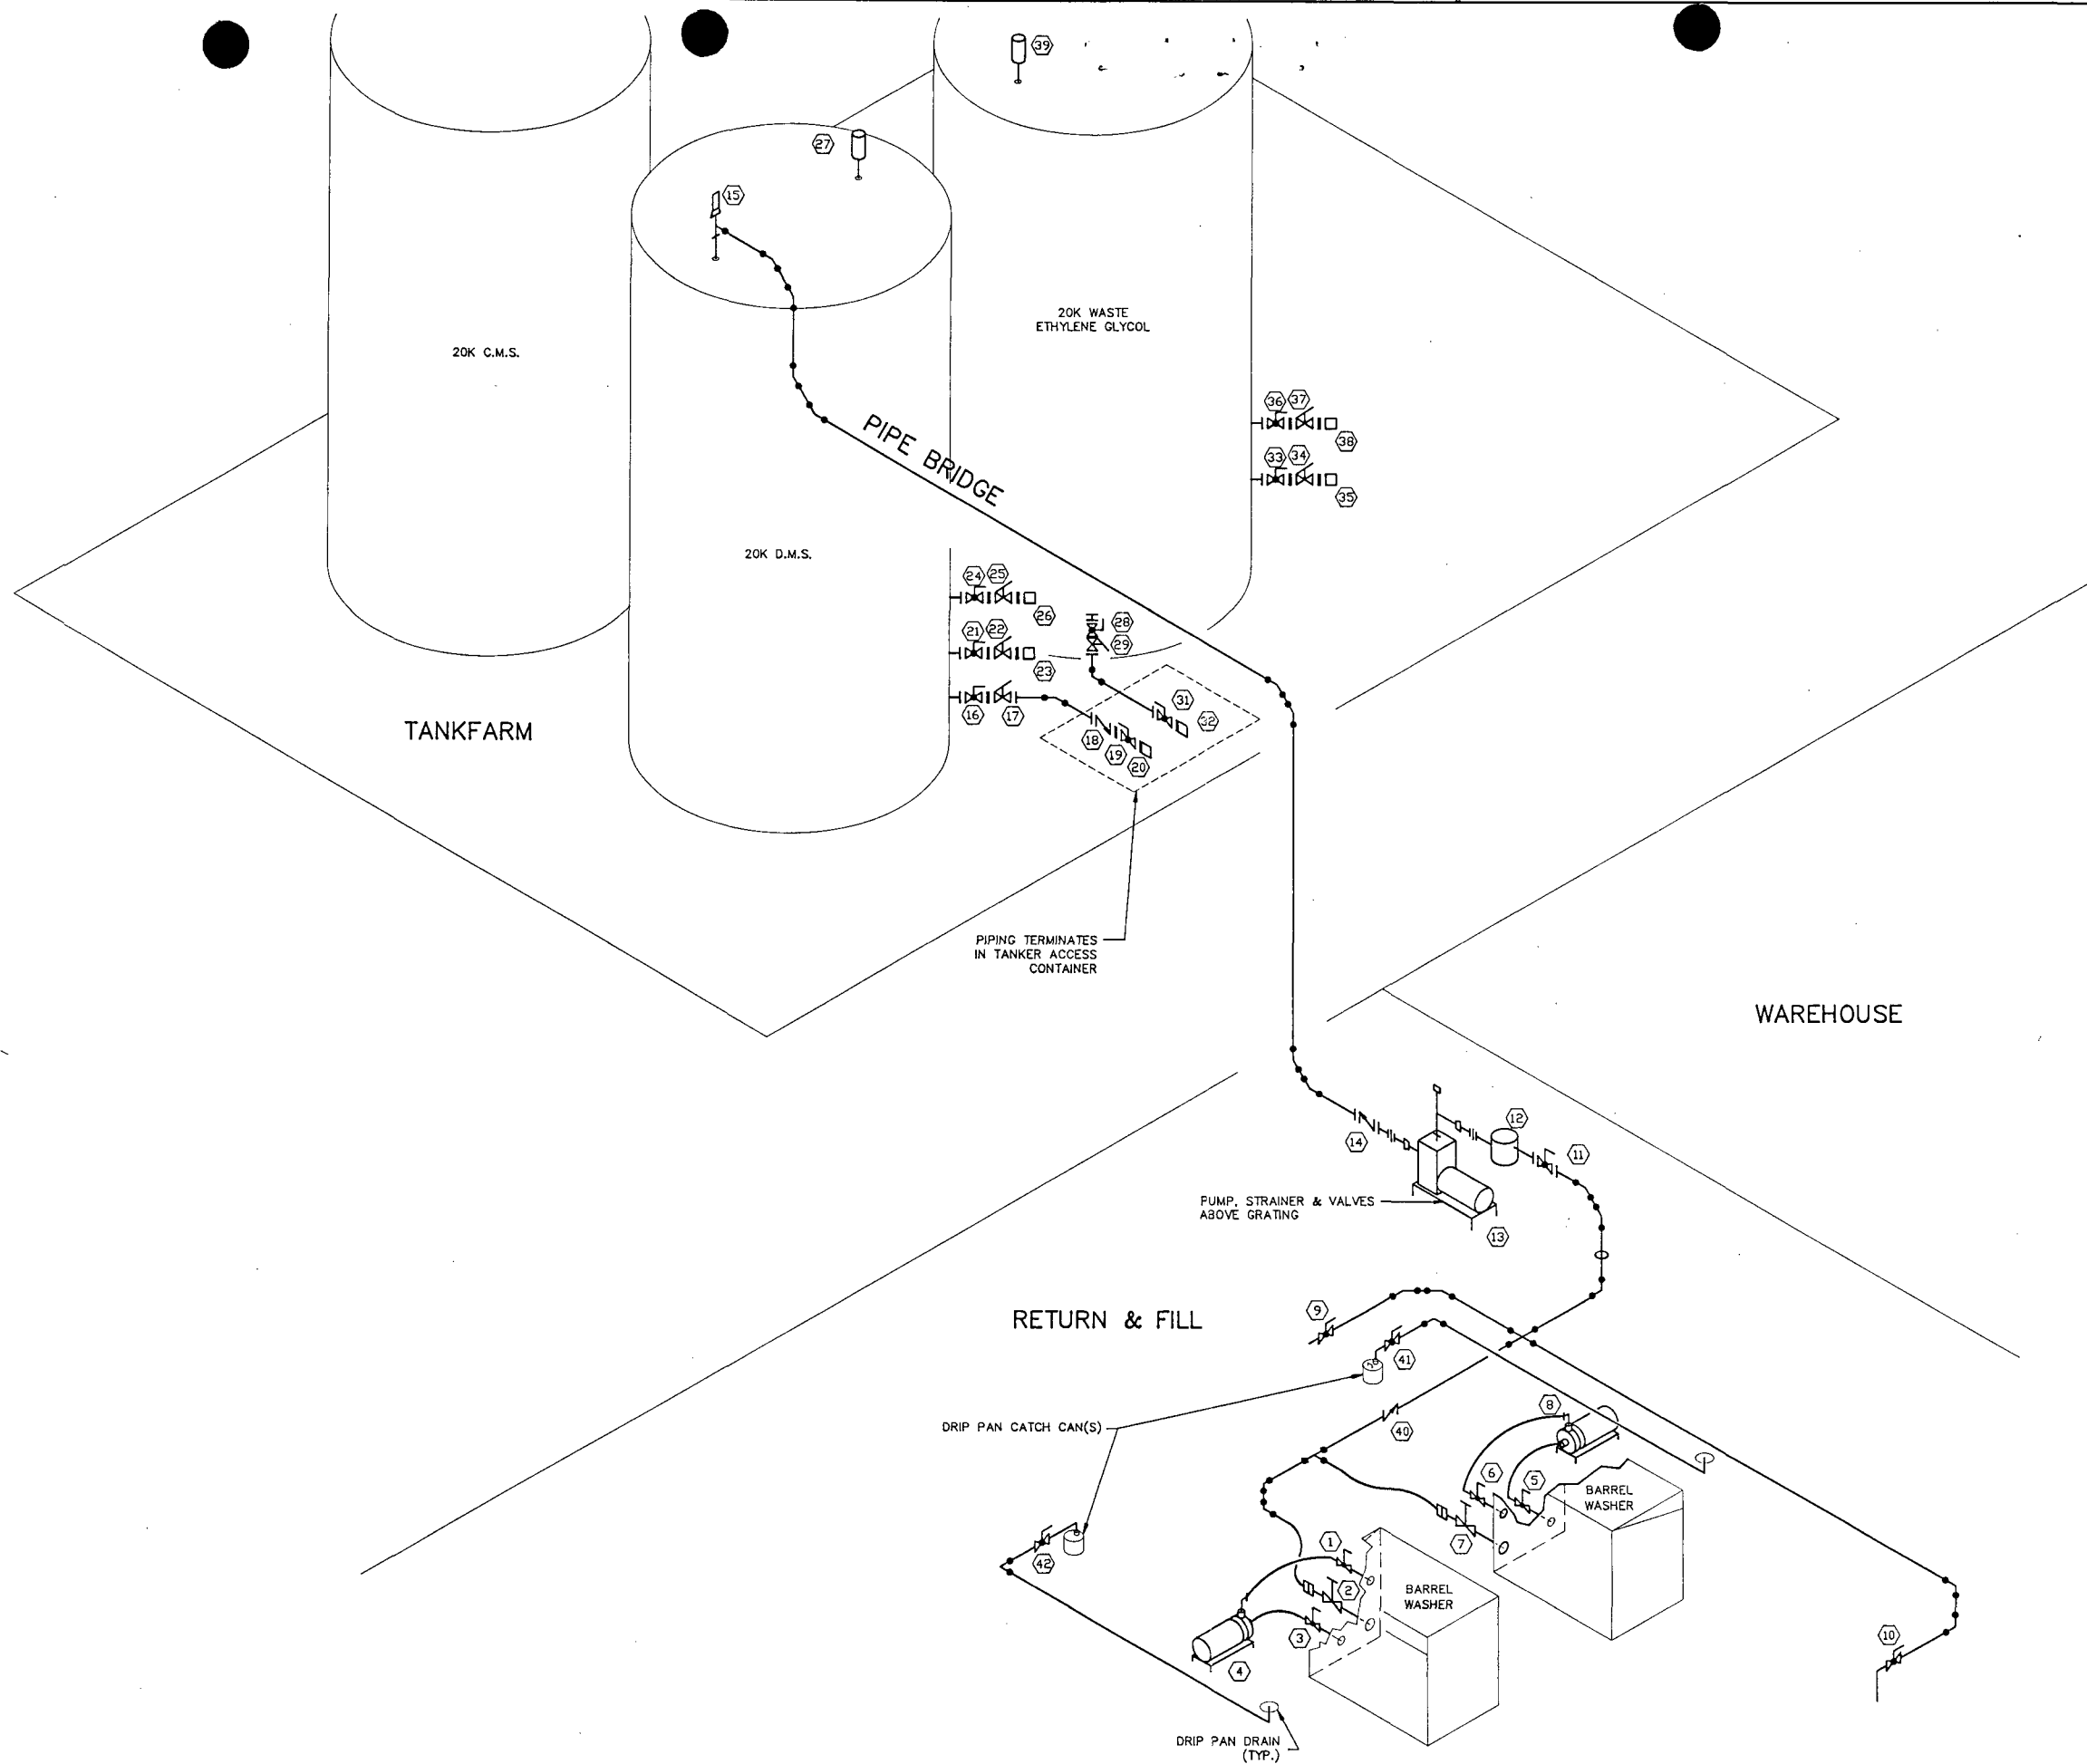

EQUIPMENT SCHEDULE	
MARK	DESCRIPTION
(1)	1 1/4" BALL VALVE (BARREL WASHER)
(2)	2" GATE VALVE
(3)	1 1/2" BALL VALVE (BARREL WASHER)
(4)	RECIRCULATING PUMP (BARREL WASHER)
(5)	1 1/2" BALL VALVE (BARREL WASHER)
(6)	1 1/4" BALL VALVE (BARREL WASHER)
(7)	2" GATE VALVE
(8)	RECIRCULATING PUMP (BARREL WASHER)
(9)	2" FLANGED BALL VALVE
(10)	2" FLANGED BALL VALVE
(11)	2" FLANGED BALL VALVE
(12)	STRAINER ASSY.
(13)	USED SOLVENT PUMP
(14)	2" FLANGED CHECK VALVE
(15)	3/8" AUTOMATIC VACUM BREAKER
(16)	3" FLANGED BALL VALVE
(17)	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
(18)	3" FLANGED CHECK VALVE
(19)	3" FLANGED BALL VALVE
(20)	3" FLANGED CAM LOCK
(21)	3" FLANGED BALL VALVE
(22)	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
(23)	3" FLANGED CAM LOCK
(24)	3" FLANGED BALL VALVE
(25)	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
(26)	3" FLANGED CAM LOCK
(27)	3" PRESSURE VACUM BREAKER
(28)	3" FLANGED BALL VALVE
(29)	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
(31)	3" FLANGED BALL VALVE
(32)	3" FLANGED CAM LOCK
(33)	3" FLANGED BALL VALVE
(34)	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
(35)	3" FLANGED CAM LOCK
(36)	3" FLANGED BALL VALVE
(37)	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
(38)	3" FLANGED CAM LOCK
(39)	3" PRESSURE VACUM BREAKER
(40)	2" CHECK VALVE
(41)	1" BALL VALVE
(42)	1" BALL VALVE

B	ADDED TAGS 40,41 & 42	MBH	KJM	-	010492
A	RELEASED FOR PART "B" PERMIT	MBH	-	-	071092
NO.	DESCRIPTION	BY	CHK	APPR	DATE


REVISIONS					
-----------	--	--	--	--	--

PROPRIETARY STATEMENT					
THIS DRAWING IS THE EXCLUSIVE PROPERTY OF SAFETY-KLEEN CORP. AND IS PROPRIETARY AND CONFIDENTIAL INFORMATION. THIS DRAWING AND THE INFORMATION CONTAINED THEREIN MUST NOT BE DUPLICATED, USED, DIVULGED, REPRODUCED, COPIED, DISCLOSED OR APPROPRIATED IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN AS EXPRESSLY AUTHORIZED BY SAFETY-KLEEN CORP. THIS DRAWING MUST BE RETURNED PROMPTLY UPON REQUEST.					

TITLE					
ENVIRONMENTAL PIPING SCHEMATIC - EXISTING					

SAFETY-KLEEN CORP.					
777 BIG TIMBER ROAD ELGIN, ILLINOIS 60123 PHONE 708-697-8460					

SCALE	BY	CHKD	APPROVED	OPERATIONS	DATE
NONE	MBH				07-09-92
SERVICE CENTER LOCATION			SC-DWG NUMBER		REV. NO.
MEDLEY, FL.			309702-GDPB200		B

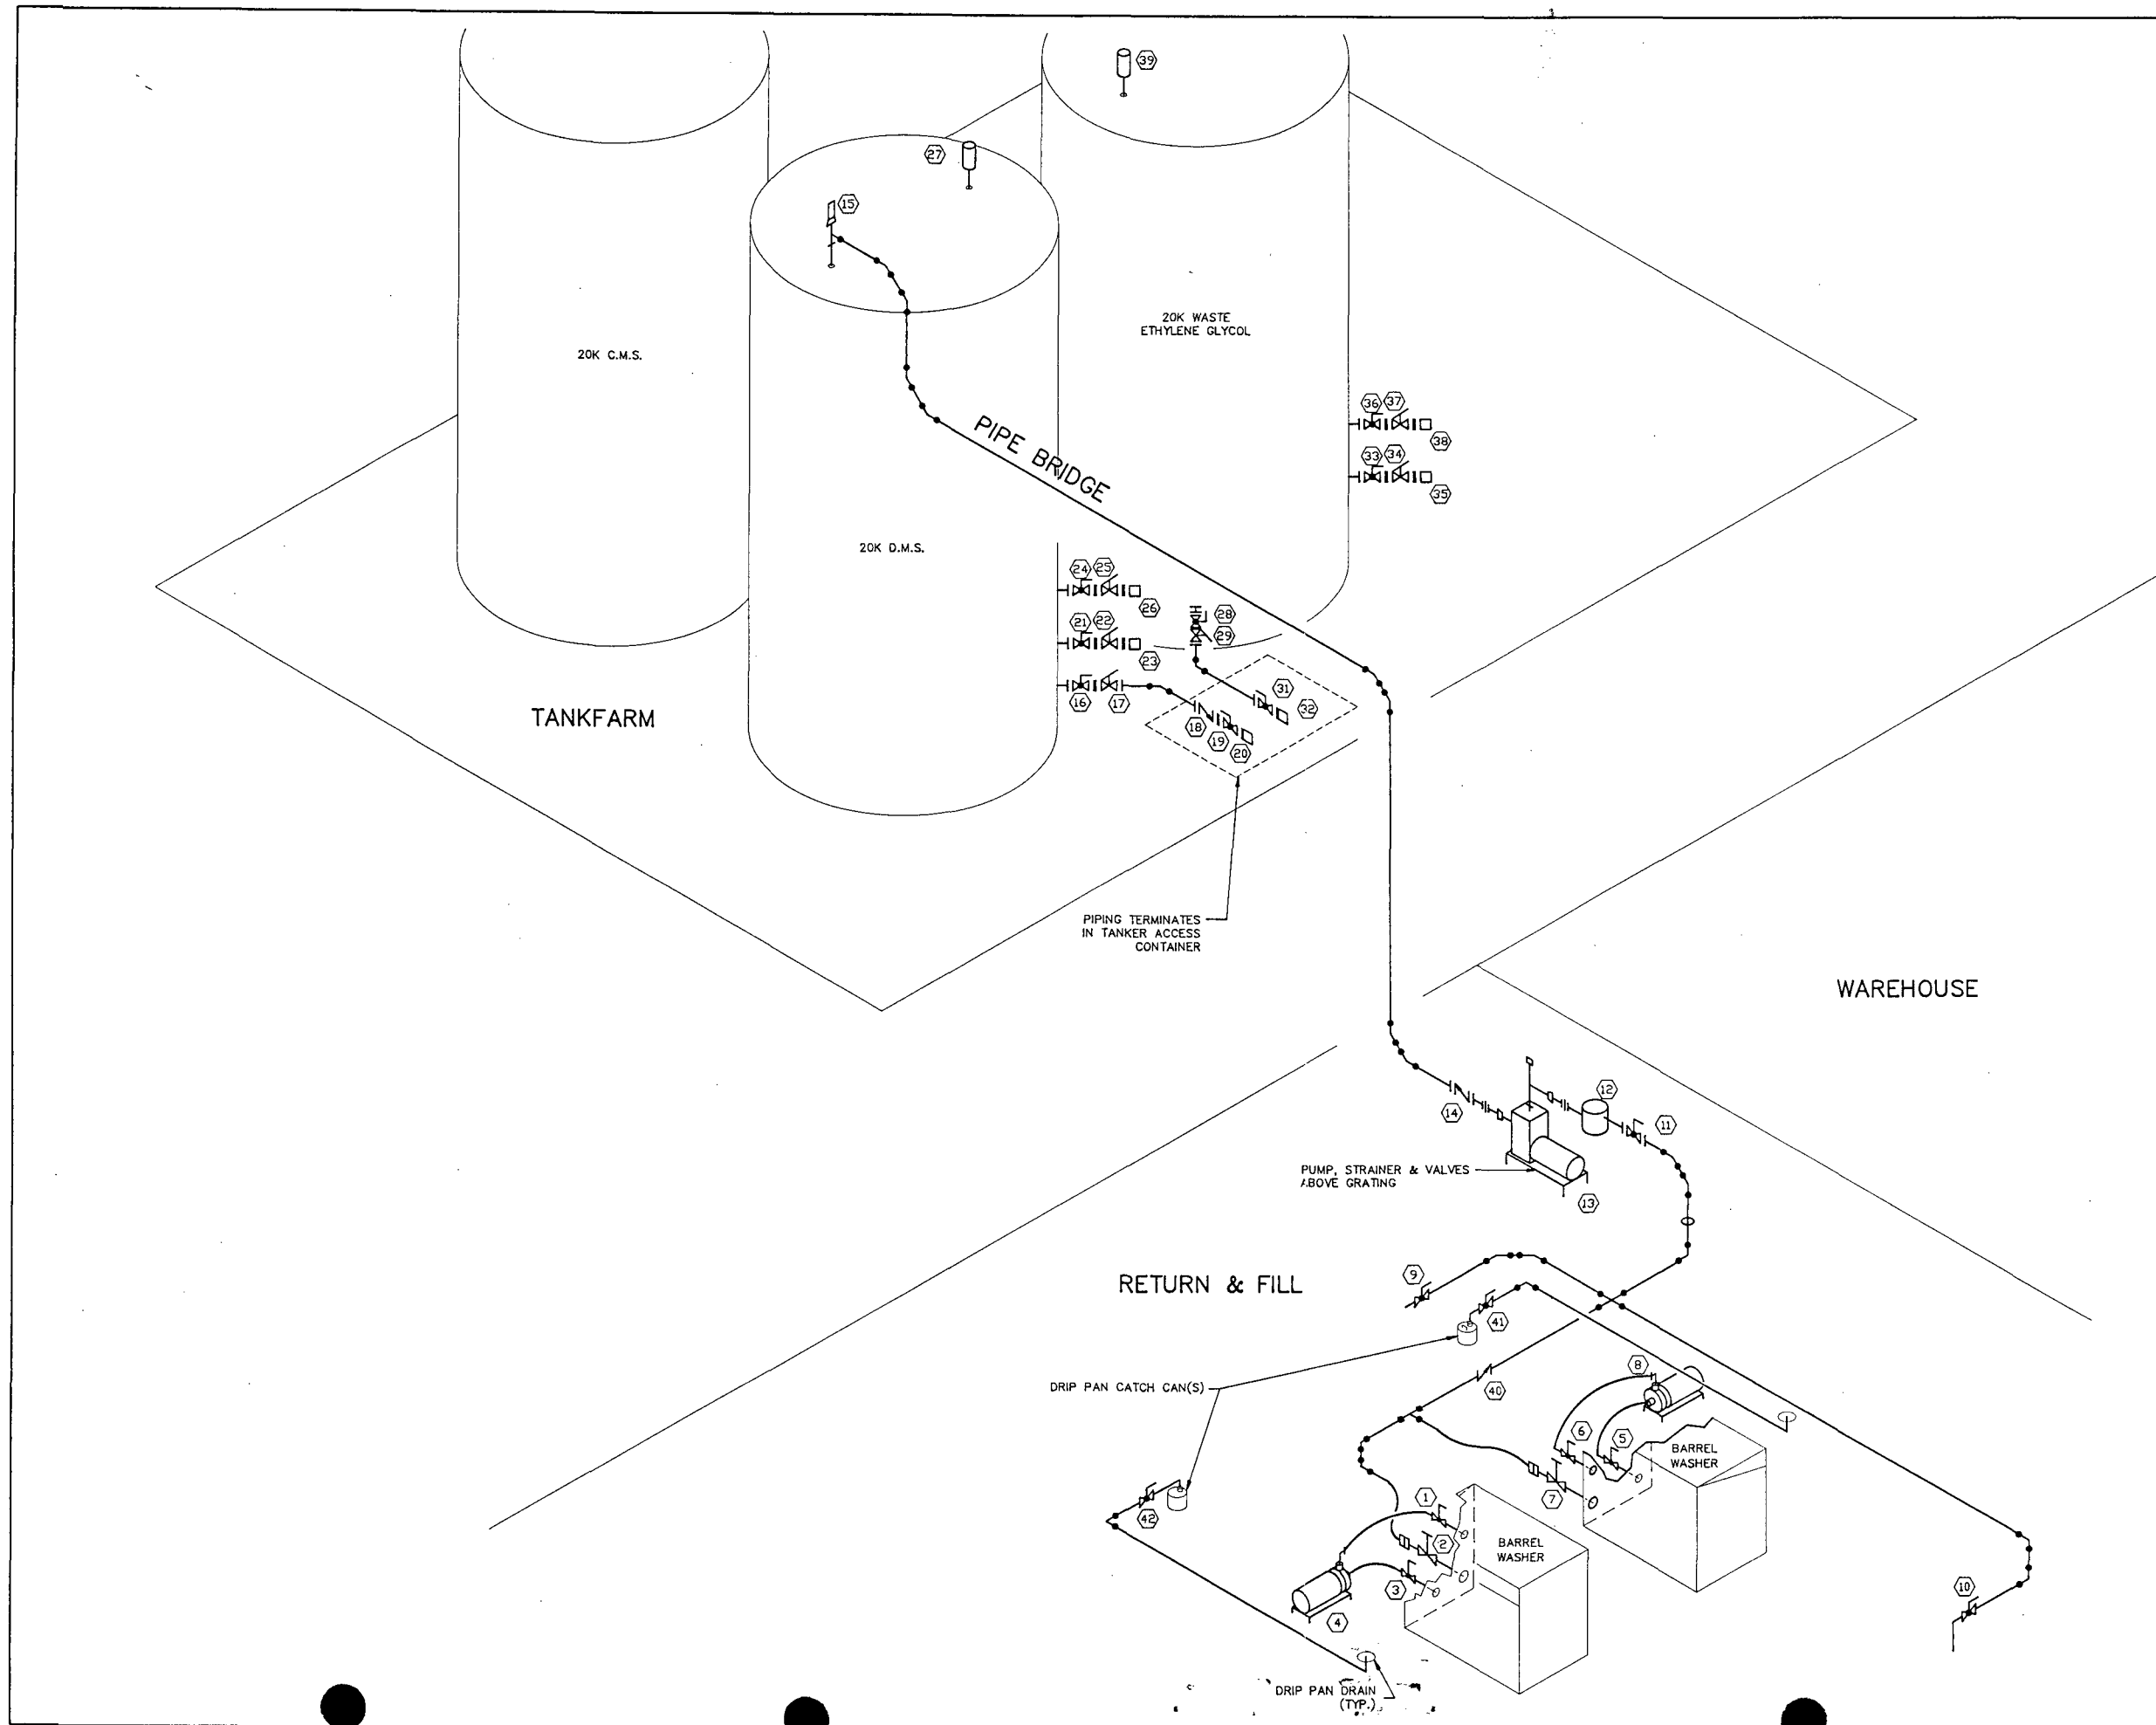

EQUIPMENT SCHEDULE	
MARK	DESCRIPTION
①	1 1/4" BALL VALVE (BARREL WASHER)
②	2" GATE VALVE
③	1 1/2" BALL VALVE (BARREL WASHER)
④	RECIRCULATING PUMP (BARREL WASHER)
⑤	1 1/2" BALL VALVE (BARREL WASHER)
⑥	1 1/4" BALL VALVE (BARREL WASHER)
⑦	2" GATE VALVE
⑧	RECIRCULATING PUMP (BARREL WASHER)
⑨	2" FLANGED BALL VALVE
⑩	2" FLANGED BALL VALVE
⑪	2" FLANGED BALL VALVE
⑫	STRAINER ASSY.
⑬	USED SOLVENT PUMP
⑭	2" FLANGED CHECK VALVE
⑮	3/8" AUTOMATIC VACUM BREAKER
⑯	3" FLANGED BALL VALVE
⑰	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
⑱	3" FLANGED CHECK VALVE
⑲	3" FLANGED BALL VALVE
⑳	3" FLANGED CAM LOCK
㉑	3" FLANGED BALL VALVE
㉒	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
㉓	3" FLANGED CAM LOCK
㉔	3" FLANGED BALL VALVE
㉕	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
㉖	3" FLANGED CAM LOCK
㉗	3" PRESSURE VACUM BREAKER
㉘	3" FLANGED BALL VALVE
㉙	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
㉚	
㉛	3" FLANGED BALL VALVE
㉜	3" FLANGED CAM LOCK
㉝	3" FLANGED BALL VALVE
㉞	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
㉟	3" FLANGED CAM LOCK
㊱	3" FLANGED BALL VALVE
㊲	3" FLANGED EXTERNAL EMERGENCY GATE VALVE
㊳	3" PRESSURE VACUM BREAKER
㊴	2" CHECK VALVE
㊵	1" BALL VALVE
㊶	1" BALL VALVE

B	ADDED TAGS 40, 41 & 42	MBH	KJM	-	010492
A	RELEASED FOR PART "B" PERMIT	MBH		-	071092
NO.	DESCRIPTION	BY	CHK	APPR	DATE

REVISIONS					
-----------	--	--	--	--	--

PROPRIETARY STATEMENT

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF SAFETY-KLEEN CORP. AND IS PROPRIETARY AND CONFIDENTIAL INFORMATION. THIS DRAWING AND THE INFORMATION CONTAINED THEREIN MUST NOT BE DUPLICATED, USED, DIVULGED, REPRODUCED, COPIED, DISCLOSED OR APPROPRIATED IN WHOLE OR IN PART FOR ANY PURPOSE OTHER THAN AS EXPRESSLY AUTHORIZED BY SAFETY-KLEEN CORP. THIS DRAWING MUST BE RETURNED PROMPTLY UPON REQUEST.

TITLE

ENVIRONMENTAL PIPING SCHEMATIC - EXISTING

SAFETY-KLEEN CORP.
777 BIG TIMBER ROAD, ELGIN, ILLINOIS 60123 PHONE 708-697-8460

SCALE	BY	CHKD	APPROVED	OPERATIONS	DATE
NONE	MBH				07-09-92
SERVICE CENTER LOCATION			SC-DWG NUMBER		REV. NO.
MEDLEY, FL.			309702-GDPB200		B