




LEGEND/NOTES:



FIRE EXTINGUISHER LOCATIONS

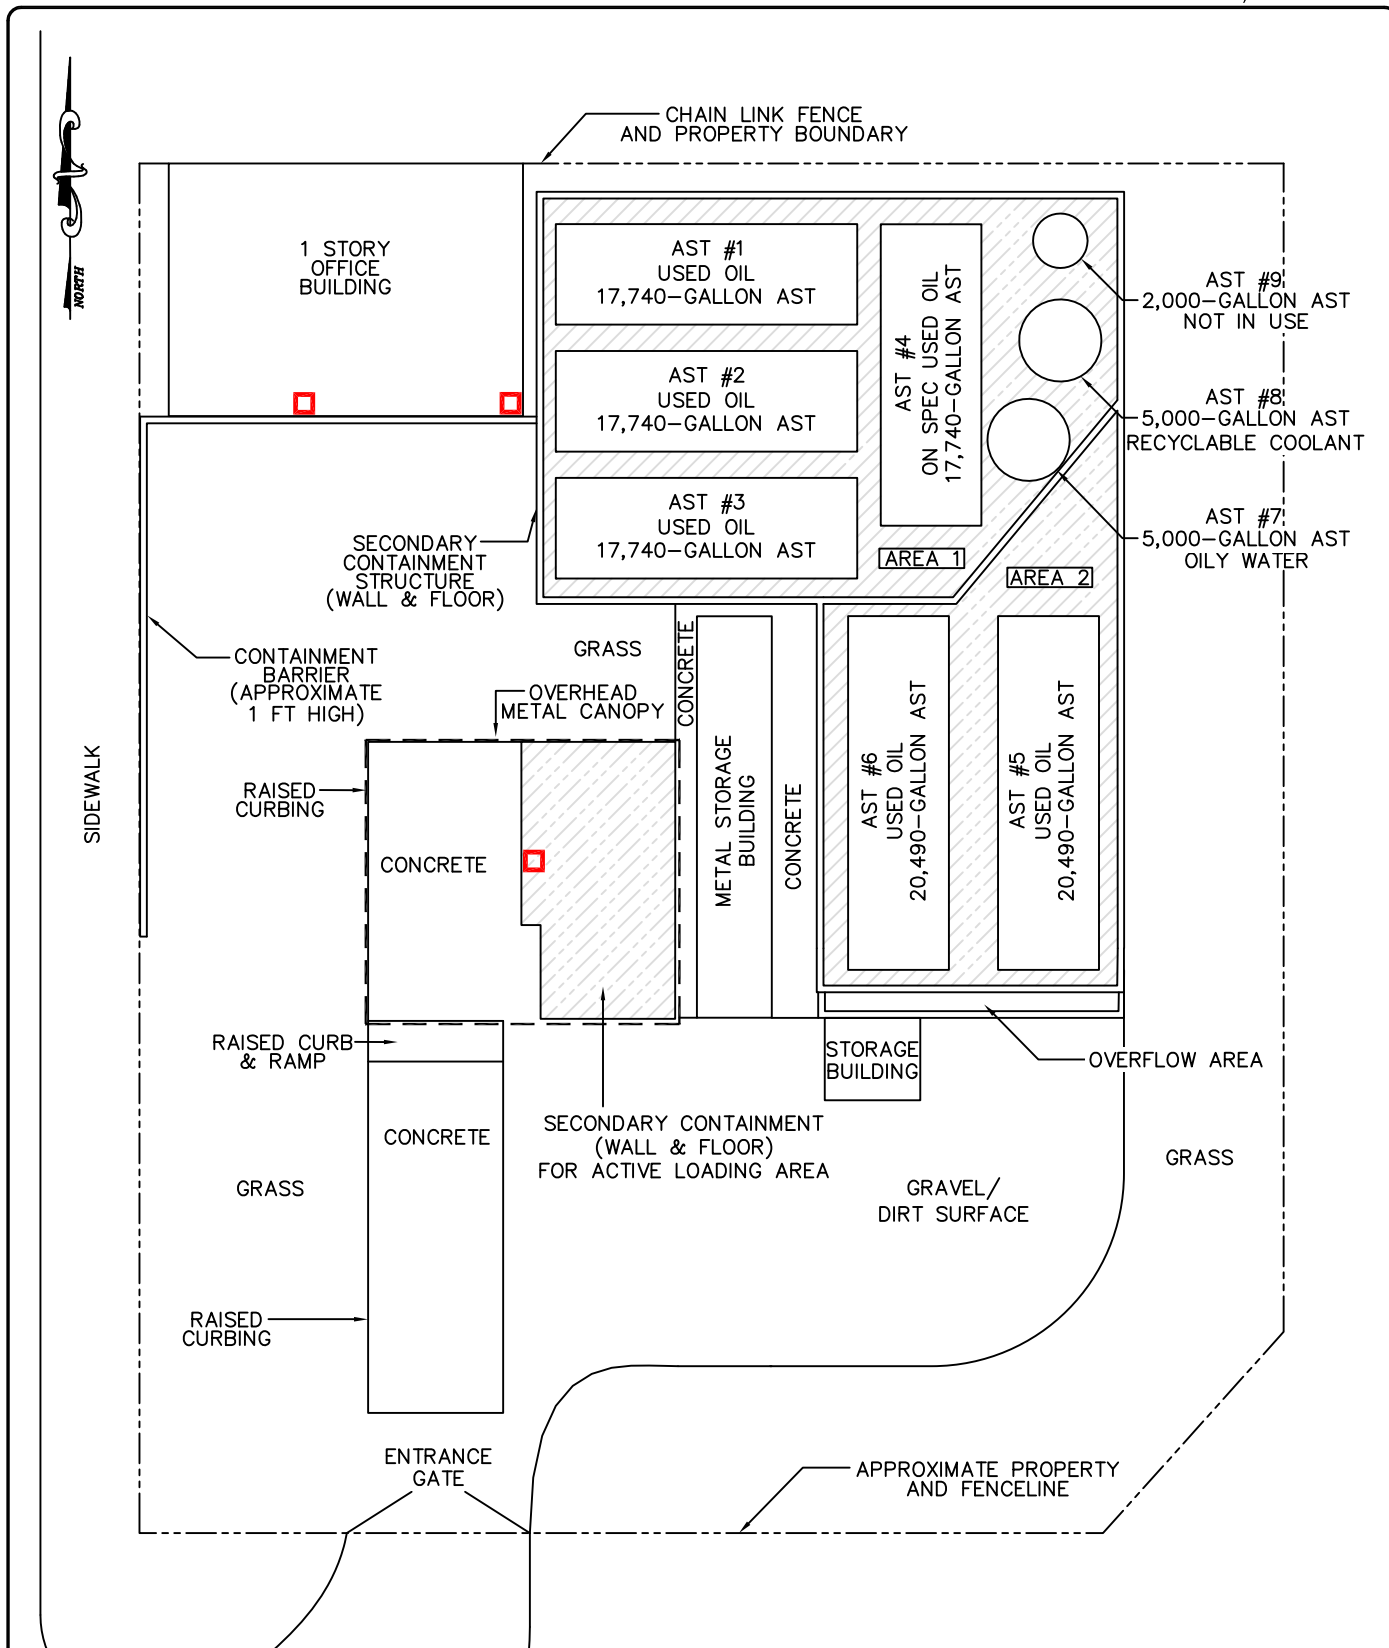

SECONDARY CONTAINMENT AREAS

NOTE: THE METAL STORAGE BUILDING IS USED FOR THE STORAGE OF 55-GALLON DRUMS CONTAINING NON-HAZARDOUS SLUDGE AWAITING FOR TRANSPORT FOR PROPER OFF-SITE DISPOSAL & SPILL CONTROL EQUIPMENT.



**Andreyev
Engineering,
Inc.**

APPROXIMATE SCALE:

1"=20'

DATE: 04/30/12

ENGINEER: JJ

PN:EPEN-11-0233

DRAWN BY: DLS

USED OIL PROCESSING PERMIT APPLICATION
**FUELS UNLIMITED INC.
(D.B.A. OILS UNLIMITED)**
509 SOUTH FRENCH AVENUE
SANFORD, SEMINOLE COUNTY, FLORIDA

SITE MAP

FIGURE 2